



Premium Forced Air
Geothermal Comfort System
Geothermal Heat Pumps
R-410A Refrigerant
2-6 Ton Dual Capacity



Installation Information

Water Piping Connections

Hot Water Generator Connections

Electrical

Startup Procedures

Troubleshooting

Preventive Maintenance



GEO SMART
E N E R G Y

Table of Contents

Model Nomenclature	5
AHRI/ISO 13256-1 Performance Ratings	6-7
ECO-Y Design Features	8-10
The Microprocessor Control System	11-14
Operation Logic Data Table	15
Water Quality	15
Dimensional Data	16-17
Physical Data	18
Auxiliary Heat Ratings	19
Auxiliary Heat Electrical Data	19
Electrical Data	19
Blower Performance Data	20-21
Reference Calculations	22
Legend and Notes	22
Operating Limits	22
Antifreeze Corrections	23
Correction Factor Tables	24
Pressure Drop	25
Performance Data	26-35
Wiring Schematics	36-39
Engineering Guide Specifications	40-42
Revision Guide	43



The ECO-Y Series is our newest offering and was designed to complement our Premium V and Premium G units. The ECO-Y units offer two-stage compressors and 5-Speed ECM blowers for high efficiency and quiet operation. It's our first residential unit to come standard with durable all-aluminum air coils for formicary corrosion protection. All models utilize ozone-safe R410A refrigerant to meet the most stringent EPA requirements. The ECO-Y Series is available in five dual capacity sizes (2-6 ton) with Copeland Scroll UltraTech™ compressors.


5-Speed ECM blower motors bridge the gap of high efficiency ECM capability with great value. ECM blowers are used to increase comfort, efficiency, and airflow flexibility. A sophisticated microprocessor sequences all components during operation for optimum performance, and provides easy-to-use troubleshooting features with fault lights and on-board diagnostics. Unit configurations include vertical top discharge (left and right return) and horizontal units with left or right return a side or end discharge. Heavy-gauge metal cabinets are fully insulated and coated with an attractive and durable powder coat paint for long lasting protection

ECO-Y Series products are performance-certified to AHRI/ISO 13256-1 standards, ETL listed, ENERGY STAR® qualified, and tested in an ISO 17025 accredited testing lab.

As a leader in the industry, we are dedicated to innovation, quality, and customer satisfaction. In fact, every unit built is exposed to a wide range of quality control procedures throughout the assembly process in our ISO9001:2008 certified manufacturing facility. At the end, it is subjected to a rigorous battery of computerized run tests to certify that it meets or exceeds performance standards for efficiency and safety, and will perform flawlessly at startup. As further affirmation of our quality standards, each unit carries our exclusive Quality Assurance emblem, signed by the final test technician.



Model Nomenclature

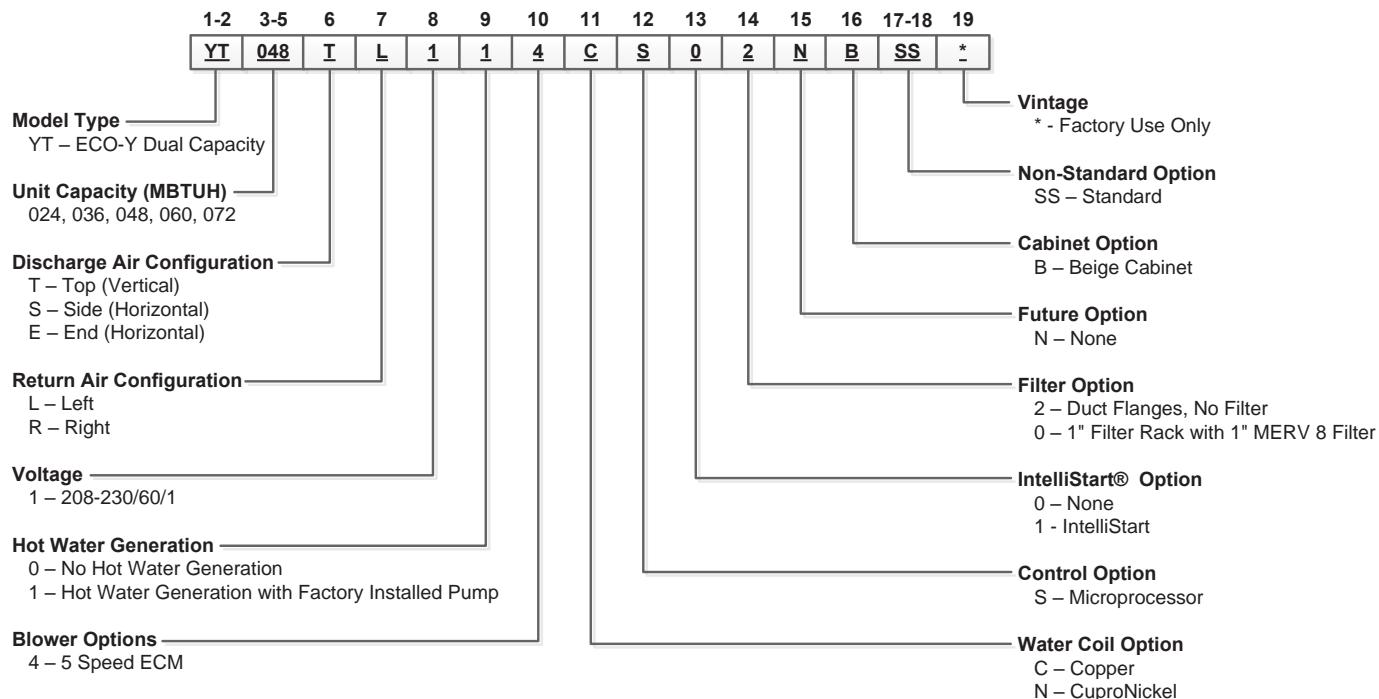

Rev.: 28 August 2014D

AHRI/ISO 13256-1 Performance Ratings

5 Speed ECM motor

AHRI/ASHRAE/ISO 13256-1

English (IP) Units

Model	Capacity Modulation	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
				Cooling EWT 86°F		Heating EWT 68°F		Cooling EWT 59°F		Heating EWT 50°F		Cooling Brine Full Load 77°F Part Load 68°F		Heating Brine Full Load 32°F Part Load 41°F	
		gpm	cfm	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
024	Full	8	800	22,000	13.9	28,300	4.9	25,100	20.6	23,500	4.4	23,100	15.6	18,900	3.8
	Part	7	600	16,300	14.7	20,800	5.3	18,800	24.4	17,000	4.5	18,200	20.6	14,900	4.1
036	Full	9	1200	33,700	13.5	42,500	4.7	38,000	19.7	35,500	4.2	35,100	15.5	26,000	3.6
	Part	8	1000	25,300	15.4	30,500	5.3	28,900	25.5	25,200	4.5	27,600	21.5	21,000	4.1
048	Full	12	1600	46,500	14.8	53,900	4.8	52,300	21.8	45,000	4.3	49,000	16.0	36,000	3.7
	Part	11	1400	34,800	16.5	39,700	5.4	39,800	27.3	32,800	4.5	38,200	22.0	28,500	4.1
060	Full	16	1800	57,200	14.3	69,000	4.5	64,100	20.7	56,500	4.0	59,900	16.5	45,300	3.4
	Part	14	1500	43,000	15.9	51,000	4.9	49,100	26.2	42,400	4.2	47,200	22.3	36,000	3.9
072	Full	18	1900	64,400	14.4	82,800	4.5	71,800	20.8	68,500	4.1	67,000	16.4	52,000	3.5
	Part	16	1550	50,400	15.7	63,600	4.8	56,800	25.3	52,800	4.1	54,200	21.9	42,500	3.7

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature

8/06/2014

Heating capacities based upon 68°F DB, 59°F WB entering air temperature

All ratings based upon 208V operation

5 Speed ECM motor ARI/ASHRAE/ISO 13256-1

Metric (SI) Units

Model	Capacity Modulation	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
				Cooling EWT 30°C		Heating EWT 20°C		Cooling EWT 15°C		Heating EWT 10°C		Cooling Brine Full Load 25°C Part Load 20°C		Heating Brine Full Load 0°C Part Load 5°C	
		water L/S	air L/S	Capacity Watts	EER (W/W)	Capacity Watts	COP	Capacity Watts	EER (W/W)	Capacity Watts	COP	Capacity Watts	EER (W/W)	Capacity Watts	COP
024	Full	0.5	377.6	6,448	4.1	8,294	4.9	7,356	6.0	6,887	4.4	6,770	4.6	5,539	3.8
	Part	0.4	283.2	4,777	4.3	6,096	5.3	5,510	7.2	4,982	4.5	5,334	6.0	4,367	4.1
036	Full	0.6	566.4	9,877	4.0	12,456	4.7	11,137	5.8	10,404	4.2	10,287	4.5	7,620	3.6
	Part	0.5	472.0	7,415	4.5	8,939	5.3	8,470	7.5	7,386	4.5	8,089	6.3	6,155	4.1
048	Full	0.8	755.2	13,628	4.3	15,797	4.8	15,328	6.4	13,189	4.3	14,361	4.7	10,551	3.7
	Part	0.7	660.8	10,199	4.8	11,635	5.4	11,665	8.0	9,613	4.5	11,196	6.4	8,353	4.1
060	Full	1.0	849.6	16,764	4.2	20,223	4.5	18,787	6.1	16,559	4.0	17,556	4.8	13,277	3.4
	Part	0.9	708.0	12,603	4.7	14,947	4.9	14,390	7.7	12,427	4.2	13,834	6.5	10,551	3.9
072	Full	1.1	896.8	18,875	4.2	24,267	4.5	21,043	6.1	20,076	4.1	19,637	4.8	15,240	3.5
	Part	1.0	731.6	14,771	4.6	18,640	4.8	16,647	7.4	15,475	4.1	15,885	6.4	12,456	3.7

Cooling capacities based upon 27°C DB, 19°C WB entering air temperature

8/06/2014

Heating capacities based upon 20°C DB, 15°C WB entering air temperature

All ratings based upon 208V operation

cfm*0.472 = l/s

gpm*0.0631 = l/s

in wg*249 = pascals

ft of hd *2990 = pascals

Energy Star Compliance Table

Model	Tier 3	
	Ground Water	Ground Loop
024	X	X
036	X	X
048	X	X
060	X	X
072	X	X

7/30/14

Energy Star Rating Criteria

In order for water-source heat pumps to be Energy Star rated they must meet or exceed the minimum efficiency requirements listed below. Tier 3 represents the current minimum efficiency water source heat pumps must have in order to be Energy Start rated.

Tier 3: 1/1/2012 – No Effective End Date Published

Water-to-Air	EER	COP
Ground Loop	17.1	3.6
Ground Water	21.1	4.1
Water-to-Water		
Ground Loop	16.1	3.1
Ground Water	20.1	3.5

AHRI/ISO 13256-1 Performance Ratings cont.

The performance standard AHRI/ASHRAE/ISO 13256-1 became effective January 1, 2000 and replaces ARI Standards 320, 325, and 330. This new standard has three major categories: Water Loop (comparable to ARI 320), Ground Water (ARI 325), and Ground Loop (ARI 330). Although these standards are similar there are some differences:

Unit of Measure: The Cooling COP

The cooling efficiency is measured in EER (US version measured in Btu/h per Watt. The Metric version is measured in a cooling COP (Watt per Watt) similar to the traditional COP measurement.

Water Conditions Differences

Entering water temperatures have changed to reflect the centigrade temperature scale. For instance the water loop heating test is performed with 68°F (20°C) water rounded down from the old 70°F (21.1°C).

Air Conditions Differences

Entering air temperatures have also changed (rounded down) to reflect the centigrade temperature scale. For instance the cooling tests are performed with 80.6°F (27°C) dry bulb and 66.2°F (19°C) wet bulb entering air instead of the traditional 80°F (26.7°C) DB and 67°F (19.4°C) WB entering air temperatures. 80.6/66.2 data may be converted to 80/67 using the entering air correction table. This represents a significantly lower relative humidity than the old 80/67 of 50% and will result in lower latent capacities.

Pump Power Correction Calculation

Within each model, only one water flow rate is specified for all three groups and pumping Watts are calculated using the following formula. This additional power is added onto the existing power consumption.

- Pump power correction = $(\text{gpm} \times 0.0631) \times (\text{Press Drop} \times 2990) / 300$

Where 'gpm' is waterflow in gpm and 'Press Drop' is the pressure drop through the unit heat exchanger at rated water flow in feet of head.

Blower Power Correction Calculation

Blower power is corrected to zero external static pressure using the following equation. The nominal airflow is rated at a specific external static pressure. This effectively reduces the power consumption of the unit and increases cooling capacity but decreases heating capacity. These Watts are significant enough in most cases to increase EER and COPs fairly dramatically over ARI 320, 325, and 330 ratings.

- Blower Power Correction = $(\text{cfm} \times 0.472) \times (\text{esp} \times 249) / 300$

Where 'cfm' is airflow in cfm and 'esp' is the external static pressure at rated airflow in inches of water gauge.

ISO Capacity and Efficiency Calculations

The following equations illustrate cooling calculations:

- ISO Cooling Capacity = Cooling Capacity (Btu/h) + (Blower Power Correction (Watts) x 3.412)
- ISO EER Efficiency (W/W) = ISO Cooling Capacity (Btu/h) x 3.412 / [Power Input (Watts) - Blower Power Correction (Watts) + Pump Power Correction (Watt)]

The following equations illustrate heating calculations:

- ISO Heating Capacity = Heating Capacity (Btu/h) - (Blower Power Correction (Watts) x 3.412)
- ISO COP Efficiency (W/W) = ISO Heating Capacity (Btu/h) x 3.412 / [Power Input (Watts) - Blower Power Correction (Watts) + Pump Power Correction (Watt)]

Comparison of Test Conditions

	ARI 320	ISO/AHRI 13256-1 WLHP	ARI 325	ISO/AHRI 13256-1 GWHP	ARI 330	ISO/AHRI 13256-1 GLHP
Cooling						
Entering Air - DB/WB °F	80/67	80.6/66.2	80/67	80.6/66.2	80/67	80.6/66.2
Entering Water - °F	85	86	50/70	59	77	77
Fluid Flow Rate	*	**	**	**	**	**
Heating						
Entering Air - DB/WB °F	70	68	70	68	70	68
Entering Water - °F	70	68	50/70	50	32	32
Fluid Flow Rate	*	**	**	**	**	**

NOTES: * Flow rate is set by 10°F rise in standard cooling test

** Flow rate is specified by the manufacturer

Part load entering water conditions not shown

WLHP = Water Loop Heat Pump; GWHP = Ground Water Heat Pump; GLHP = Ground Loop Heat Pump

Conversions:



$$\text{Airflow (lps)} = \text{cfm} \times 0.472;$$

$$\text{ESP (Pascals)} = \text{ESP (in wg)} \times 249;$$

$$\text{WaterFlow (lps)} = \text{gpm} \times 0.0631;$$

$$\text{Press Drop (Pascals)} = \text{Press Drop (ft hd)} \times 2990$$

ECO-Y Design Features

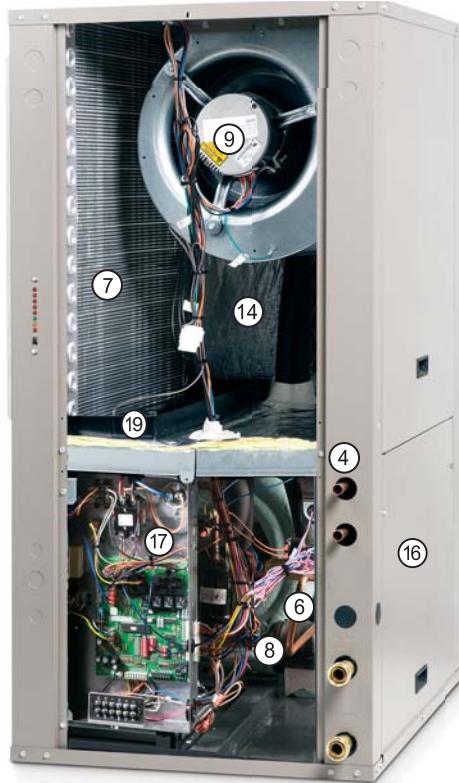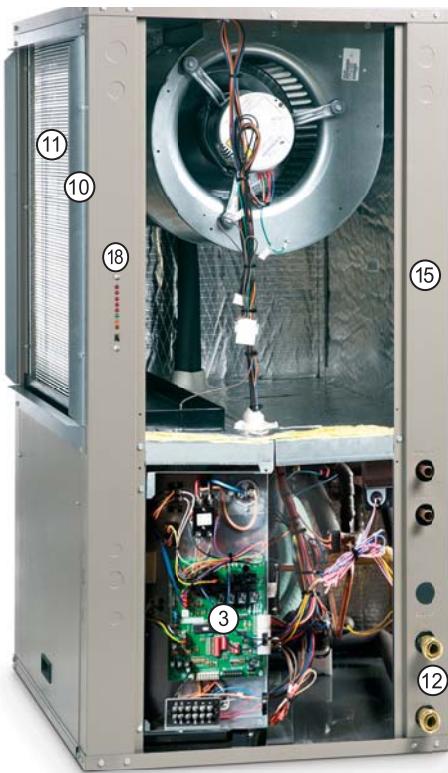

- ① **COMPRESSOR:** Copeland Scroll UltraTech™ (dual capacity) represent the latest technology (not shown)
- ② **DOUBLE ISOLATED COMPRESSOR:** Double isolated compressor mounting to reduce noise and vibration (not shown)
- ③ **MICROPROCESSOR CONTROLS**
- ④ **OPTIONAL HOT WATER ASSIST:** Provides free hot water in cooling and very high efficiency hot water generation in heating mode. Internally mounted pump
- ⑤ **COAXIAL HEAT EXCHANGER:** Standard large high efficiency copper (optional cupronickel) coax with our exclusive void-free and robotically applied ThermaShield insulation coating
- ⑥ **BALANCED PORT/BIDIRECTIONAL EXPANSION VALVE:** Balanced port bidirectional expansion valve for rock steady superheat control and reliable efficiency and operation at any condition
- ⑦ **AIR COIL:** All aluminum air coil to prevent formicary corrosion.
- ⑧ **DISCHARGE MUFFLER:** Helps quiet compressor gas pulsations
- ⑨ **5-SPEED ECM BLOWER MOTOR:** Standard high efficiency 5-Speed ECM motor.
- ⑩ **RETURN AIR CONNECTION:** Standard with return air duct flanges and no filter. Optional 1" filter rails or 1" filter rack with 1" MERV8 filter (not shown)
- ⑪ **FILTER:** High holding capacity 1 in. pleated MERV 8 filter is optional (not shown)
- ⑫ **SWIVEL LOOP CONNECTIONS:** Leak free swivel water connections provide a hand tight gasket connection that easily handles the temperature extremes of geothermal earth loops
- ⑬ **INTELLISTART®:** Optional single phase soft starter
- ⑭ **INSULATION:** Cleanable foil lined insulation to prevent mold growth; corrosion resistant composite drain pan
- ⑮ **CABINET FINISH:** Heavy gauge galvanized sheet metal cabinet has 1,000 hr. salt spray rated gray powder coat paint for long life
- ⑯ **ACCESS PANELS:** Lift out front bottom access panel, lift out panels for easier removal and servicing
- ⑰ **CONTROL BOX:** Unit controls feature quick connect wiring harnesses for easy servicing. Separate knockouts for LV and two for power on two sides allow easy access to the control box. 75VA transformer assures adequate controls power
- ⑱ **LED STATUS LIGHTS:** Mounted higher on the unit
- ⑲ **COMPOSITE DRAIN PAN:** Custom molded and positively sloped for condensate drainage (not shown)

ECO-Y Design Features cont.

What's New?

- AHRI/ISO 13256-1 Ratings meet ENERGY STAR® requirements
- ENERGY STAR® Most Efficient recognized - efficiency that meets or exceeds minimum requirement.
- All aluminum air coils prevent formicary corrosion
- Latest technology compressors
 - Copeland UltraTech™ K5 Compressors in dual capacity units (sizes 024, 036, 048, 060, 072)
- Discharge line mufflers on all models to help quiet compressor discharge gas pulsations.
- 5-Speed ECM blower motor for high efficiency
- Cabinet Design – Improved design of access panels for ease of access
- Cabinet Configurations – Vertical left or right return, horizontal left or right return with either end or side air discharge

Application Flexibility

- Safe, efficient operation in a wide range of liquid temperatures (20°F to 120°F) and flow rates (as low as 1.5 gpm/ton in open loop applications when EWT >50°F)
- Top air discharge for upflow in vertical units, side or end discharge for horizontal units
- True left or right return air locations—vertical units include duct collar/return air flanges
- 5-Speed ECM blower motors provide ECM efficiency at PSC capability
- Narrow cabinet for easy movement through doorways
- Internally trapped condensate piping on vertical units for neat, compact installation
- Optional field-installed auxiliary electric heater
- Corner-located electrical box for field wiring from two sides
- Fuse protected loop pump power block for easy wiring
- Relay to control field-mounted accessories
- Field-selectable freeze detection setting for well or closed loop systems
- Simple to install and simple to service - Unlike some geothermal heat pumps, cabinet allows plenty of access and has spacious interior.

Operating Efficiencies

- AHRI/ISO 13256-1 rating for heating COPs, cooling EERs, and low water flow requirements
- Optional hot water generator with internal pump generates hot water at considerable savings while improving overall system efficiency
- High-stability expansion valve delivers optimum refrigerant flow over a wide range of conditions and provides bidirectional operation without troublesome check valves
- Efficient scroll compressors operate quietly
- Coaxial tube water-to-refrigerant heat exchanger operates at low liquid pressure drops
- Convoluted copper water tube functions efficiently at low flow rates

- Large, low-RPM blowers with 5-Speed ECM motors provide quiet and efficient air movement with high static capability.
- Utilizes the ozone-friendly R-410A refrigerant which produces higher efficiencies and warmer discharge air temperatures

Service Advantages

- Removable panels: three for the compressor compartment and one (on horizontals) or two (on verticals) for the air handling compartment to provide quick access to all internal components with ductwork in place
- Easily accessible thermal expansion valve
- Brass, swivel-type water connections for quick connection union, and elimination of wrenches and sealants during installation; sweat type connections are on the hot water generator
- Insulated divider and separate air handling/compressor access panels permit service testing without air bypass
- Designed for front access in tight applications
- LED fault and status lights
- Provides enhanced service information including sensor inputs, fault history, and much more
- Detachable thermostat connection strip for wiring convenience
- Hot water pump shut-off switch for easy startup and service
- Control box and blower motors have quick-attach wiring plugs for easy removal
- Internal drop-out blower with permanently-lubricated ball bearing motor
- High- and low-pressure service ports in refrigerant circuit.
- Blower and transformer powered from auxiliary heat supply (when installed) to provide emergency heat with open compressor circuit breaker

Product Quality

- Heavy-gauge steel cabinets are painted with durable powder coat paint for long lasting beauty and service
- Coaxial heat exchanger, refrigerant suction lines, hot water generator coil, and all water pipes are fully insulated to reduce condensation problems in low temperature operation
- All aluminum air coils prevent formicary corrosion.
- Noise reduction features include double isolation mounted compressors and soft starting blower motors; insulated compressor compartment; interior cabinet insulation using 1/2 in. coated glass fiber
- Safety features include high- and low-pressure refrigerant controls to protect the compressor, condensate overflow protection, freeze detection sensor to safeguard the coaxial heat exchanger, blower start detection, hot water high-limit, and fault lockout enables emergency heat and prevents compressor operation until thermostat or circuit breaker is reset

ECO-Y Design Features cont.

Microprocessor Benefits

- Digital auto-changeover thermostat with 3-stage heating and 2 stage cooling holds precise temperature and provides varying blower speed control
- Component sequencing delays for quiet startup, shutdown, and timed staging of auxiliary electric heat.

Options and Accessories

- IntelliZone2 24V Zone System: The IntelliZone2 24V zoning system provides 4 zones (Dual Capacity), or 2 zones (Single Speed) of individualized comfort
- Optional cupronickel heat exchangers for open loop applications
- Optional hot water generator with internally mounted pump and water heater plumbing connector
- Electronic auto-changeover thermostat with 3-stage heating/2-stage cooling and indicator LEDs (non-communicating)
- Optional 1" MERV 8 Filter
- 24 Volt 1 in. electronic air cleaner
- 90% efficient, cleanable electrostatic filters
- Closed loop flow center in several sizes
- Auxiliary electric heater
- Hose kits
- Additional accessory relay
- IntelliStart soft starter

Manufacturing Quality

- All units are computer run-tested, with conditioned source water, in all modes to ensure efficiency and reliability
- All refrigerant brazing is performed in a nitrogen atmosphere
- All units are deep evacuated to less than 150 microns prior to refrigerant charging
- All joints are helium leak-tested to ensure an annual leak rate of less than 1/4 ounce
- All major components bar coded; eliminating possibility of mismatched parts built into unit
- All assembly technicians thoroughly trained in proper quality procedures
- All units have model number and serial number embedded in control for local or remote retrieval
- Made in an ISO 9001:2008 certified manufacturing facility
- Engineering labs are ISO 17025 accredited

Microprocessor Control System

Startup

The unit will not operate until all the inputs and safety controls are checked for normal conditions. At first power-up, a four minute delay is employed before the compressor is energized.

Component Sequencing Delays

Components are sequenced and delayed for optimum space conditioning performance.

Accessory Relay

An accessory relay on the control board allows for field connection of solenoid valves, electronic air cleaners, etc. The accessory relay has a normally open output and a normally closed output.

Short Cycle Protection

The control employs a minimum "off" time of four minutes to provide for short cycle protection of the compressor.

Condensate Overflow Protection

The microprocessor control board incorporates an impedance sensing liquid sensor at the top of the drain pan. Upon a continuous 30-second sensing of the condensate, compressor operation is suspended (see Fault Retry), and the condensate overflow lockout LED begins flashing.

Shutdown Mode

A 24VAC common signal to the "shutdown" input on the control board puts the unit into shutdown mode. Compressor, hot water pump and fan operation are suspended.

Safety Controls

The microprocessor control receives separate signals for a high pressure switch for safety, a low pressure switch to prevent loss of charge damage, and a low suction temperature thermistor for freeze sensing. Upon a continuous 30-second measurement of the fault (immediate for high pressure), compressor operation is suspended, the appropriate lockout LED begins flashing. (Refer to the "Fault Retry" section below.)

Testing

The microprocessor control allows service personnel to shorten most timing delays for faster diagnostics. (Refer to the Field Selection DIP switch SW2-1 in the Microprocessor Control section.)

Fault Retry

All faults are retried twice before finally locking the unit out. An output signal is made available for a fault LED at the thermostat. The "fault retry" feature is designed to prevent nuisance service calls.

Diagnostics

The microprocessor control board allows all inputs and outputs to be displayed on the LEDs for fast and simple control board diagnosis. (Refer to the Field Selection DIP Switch SW2-1 in the Microprocessor Control section.)

Resistance Heat Control (208-230 Units)

The electric heat control module contains the appropriate high-voltage control relays. Control signals energize the relays in the proper sequence, and the LED display board indicates which stages are energized.

Hot Water High Limit (Domestic Hot Water Option)

This mode occurs when the hot water input temperature is at or above 130°F for 30 continuous seconds. The HWG limit status LED on the unit illuminates and the hot water pump de-energizes. Hot water pump operations resume on the next compressor cycle or after 15 minutes of continuous compressor operation during the current thermostat demand cycle.

Hot Water Justification

Since compressor hot gas temperature is dependant on loop temperature in cooling mode, loop temperatures may be too low to allow proper heating of water. The control will monitor water and refrigerant temperatures to determine if conditions are satisfactory for heating water. The HWG limit status LED on the unit illuminates when conditions are not favorable for heating water.

Heating Operation Heat, 1st Stage (Y1)

The fan motor is started on tap speed G immediately, the loop pump is energized 5 seconds after the "Y1" input is received, and the compressor is energized on low capacity 10 seconds after the "Y1" input. The fan is switched to Y1 tap speed 15 seconds after "Y1" input. The hot water pump is cycled 30 seconds after the "Y1" input.

Heat, 2nd Stage (Y1,Y2)

The second stage compressor will be activated 5 seconds after receiving a "Y2" input as long as the minimum first stage compressor run time of 1 minute has expired. The blower changes from Y1 tap speed to Y2 tap speed 15 seconds after the "Y2" input.

Microprocessor Control System cont.

Heat, 3rd Stage (Y1,Y2,W)

The hot water pump is de-energized which directs all heat to satisfy the thermostat. The 1st stage of resistance heat is energized 10 seconds after "W" input, and with continuous 3rd stage demand, the second stage of resistance heat will be energized after 5 minutes.

Emergency Heat (W only)

The fan is started on W tap speed, and the first stage of resistance heat is energized 10 seconds after the "W" input. Continuing demand will engage the second stage of resistance heat after 2 minutes.

Cooling Operation

In all cooling operations, the reversing valve directly tracks the "O" input. Thus, anytime the "O" input is present, the reversing valve will be energized.

Cool, 1st Stage (Y1,O)

The blower motor and hot water pump are started immediately, the loop pump(s) is energized 5 seconds after the "Y1" input is received. The compressor will be energized (on low capacity for Dual Capacity units) 10 seconds after the "Y1" input. The ECM blower will shift from tap speed G to Y1 tap speed 15 seconds after the "Y1" input.

Cool, 2nd Stage (Y1, Y2, O)

The second stage compressor will be activated 5 seconds after receiving a "Y2" input as long as the minimum first stage compressor run time of 1 minute has expired. The blower changes to Y2 tap speed 15 seconds after the "Y2" input.

Fan (G only)

The fan starts on low speed. Regardless of fan input "G" from thermostat, the fan will remain on low speed for 30 seconds at the end of each heating, cooling or emergency heat cycle.

Lockout Conditions

During lockout mode, the appropriate unit and thermostat lockout LEDs will illuminate. The compressor, loop pump, hot water pump, and accessory outputs are de-energized. The fan will continue to run on low speed. If the thermostat calls for heating, emergency heat operation will occur.

All lockout modes can be reset at the thermostat after turning the unit off, then on, which restores normal operation but keeps the unit lockout LED illuminated. Interruption of power to the unit will reset a lockout without a waiting period and clear all lockout LEDs.

High Pressure

This lockout mode occurs when the normally closed safety switch is opened momentarily (set at 600 PSI).

Low Pressure

This lockout mode occurs when the normally closed low pressure switch is opened for 30 continuous seconds (set at 40 PSI).

Microprocessor Control System cont.

Freeze Sensing (Water Flow)

This lockout mode occurs when the freeze thermistor temperature is at or below the selected freeze sensing point (well 30°F or loop 15°F) for 30 continuous seconds.

Condensate Overflow

This lockout mode occurs when the condensate overflow level has been reached for 30 continuous seconds.

Fan RPM

The control board monitors fan RPM to sense operation. This lockout mode occurs if the fan RPM falls below the low RPM limit (100 RPM) for 30 continuous seconds.

Thermostat Displays

Fault Flash

When using a TA32W02 or TP32W03 thermostat and SW2-8 is in the pulsing "L" position, FaultFlash will enable a user to view the thermostat and count the fault indicator flashes to determine the lockout condition the unit is experiencing.

FaultFlash Thermostats

TA32W02 and TP32W03 Thermostats	
Thermostat Display Lockout Code	Lockout Description
2 Flashes	High Pressure Fault
3 Flashes	Low Pressure Fault
4 Flashes	Not Applicable
5 Flashes	Water Flow Fault
6 Flashes	Not Applicable
7 Flashes	Condensate Fault
8 Flashes	Voltage out of Range
9 Flashes	RPM Fault

Microprocessor Control System cont.

DIP Switch Settings

Prior to powering unit, ensure that all DIP switches on SW2 & SW3 are set properly according to the tables below.

FACTORY SETUP DIP SWITCHES (SW3)				
DIP SWITCH NUMBER	DESCRIPTION		OFF POSITION	ON POSITION
SW 3- 1	Dual Capacity/Single-Speed Configures the control for single-speed compressor operation or dual capacity operation.		Dual Capacity Operation	Single-Speed Operation
SW 3- 2	Zoned/Finish on Second Stage This switch allows the unit to down stage with the thermostat when off and finish with second stage when on. Finish on second stage reduces stage changing in reciprocating dual capacity compressors.		Normal - All Other Systems	Finish on 2nd - Unzoned Dual Capacity
SW 3- 3	No RPM/RPM Configures the control to monitor the RPM output of an Variable Speed ECM blower motor. When using IntelliZone, 5-Speed ECM or a PSC fan motor, the control should be configured for "NO RPM" sensing.		PSC or 5-Speed ECM Fan/RPM Monitoring Disabled	Variable Speed ECM Fan/RPM Monitoring Enabled
SW 3- 4	Electric heat and ECM Allows backward compatibility with older models. In the Off position this switch allows older electric heat board (17P501A01) and older ECM (square end) compatibility. On is for all newer EH board (17P514A01) and ECM (round end).		Old EH & Old ECM	Normal
SW 3- 5	On dual capacity units this switch allows stage change: on the fly when off, and 1 minute delay when on. A delay is required on all reciprocating dual capacity units.		Dual-Capacity Models	N/A

FIELD SELECTION DIP SWITCHES (SW2)				
DIP SWITCH NUMBER	DESCRIPTION		OFF POSITION	ON POSITION
SW 2- 1	Service Test Mode On the control, allows field selection of "NORMAL" or "TEST" operational modes. Test mode accelerates most timing functions 16 times to allow faster troubleshooting. Test mode also allows viewing the "CURRENT" status of the fault inputs on the LED display.		Test Mode	Normal Speed Operation
SW 2- 2	Low Water Coil Limit Allows field selection of freeze thermistor fault sensing temperatures for well water (30°F) or antifreeze-protected (15°F) earth loops.		Loop Water Freeze Detection 15° F	Well Water Freeze Detection 30° F
SW 2- 3	Accessory Relay Allows field selection of the accessory relay to operate with the compressor or fan.		Acc Relay Tracks Fan	Acc Relay Tracks Compressor
SW 2- 4	Fan Speed Control Not Applicable		N/A	N/A
SW 2- 5	Auxiliary Off Disables 3rd-stage Heating. Full emergency heat would still be available if needed.		Disable Heating Stage 3	Enable Heating Stage 3
SW 2- 6	Diagnostics Inputs Allows viewing the inputs from the thermostat to the control board such as Y1, Y2, O, G, W, SL1-In on the LED display.		Diagnostic Inputs Viewed at LEDs	Normal Display Viewed at LEDs
SW 2- 7	Diagnostics Outputs Allows viewing the outputs from the control board such as compressor, reversing valve, blower, hot water pump, and loop pump on the LED display.		Diagnostic Outputs Viewed at LEDs	Normal Display Viewed at LEDs
SW 2- 8	Thermostat Selection Configures the control for a pulsed lockout signal (FaultFlash thermostats) or continuous lockout signal.		Pulsed "L" signal	Continuous "L" signal

Operation Logic Data Table

Operation Logic Table	Heating					Cooling		
	STG1	STG2	STG3	EMERG	Fan Only	STG1	STG2	Fan Only
Compressor	On	On	On	Off	Off	On	On	Off
Reversing Valve	Off	Off	Off	Off	Off	On	On	On
Aux Heat	Off	Off	Staged	Staged	Off	Off	Off	Off
Acc Relay	On	On	On	Off	Off	On	On	Off
5 Speed ECM	Med Low	Med High	High	High	Low	Med Low	Med High	Low
T-Stat Signal	Y1	Y1,Y2	Y1,Y2,W	W	G	Y1,O	Y1,Y2,O	G

2/13/2012


Water Quality

In ground water situations where scaling could be heavy or where biological growth such as iron bacteria will be present, a closed loop system is recommended. The heat exchanger coils in ground water systems may, over a period of time, lose heat exchange capabilities due to a buildup of mineral deposits inside. These can be cleaned, but only by a qualified service mechanic, as special solutions and pumping equipment are required.

Hot water generator coils can likewise become scaled and possibly plugged. In areas with extremely hard water, the owner should be informed that the heat exchanger may require occasional flushing. Units with cupronickel heat exchangers are recommended for open loop applications due to the increased resistance to build-up and corrosion, along with reduced wear caused by acid cleaning. Failure to adhere to the guidelines in the water quality table could result in the loss of warranty.

Material		Copper	90/10 Cupro-Nickel	316 Stainless Steel
pH	Acidity/Aalkalinity	7- 9	7 - 9	7 - 9
Scaling	Calcium and Magnesium Carbonate	(Total Hardness) less than 350 ppm	(Total Hardness) less than 350 ppm	(Total Hardness) less than 350 ppm
Corrosion	Hydrogen Sulfide	Less than .5 ppm (rotten egg smell appears at 0.5 PPM)	10 - 50 ppm	Less than 1 ppm
	Sulfates	Less than 125 ppm	Less than 125 ppm	Less than 200 ppm
	Chlorine	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Chlorides	Less than 20 ppm	Less than 125 ppm	Less than 300 ppm
	Carbon Dioxide	Less than 50 ppm	10 - 50 ppm	10- 50 ppm
	Ammonia	Less than 2 ppm	Less than 2 ppm	Less than 20 ppm
	Ammonia Chloride	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Ammonia Nitrate	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Ammonia Hydroxide	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
	Ammonia Sulfate	Less than .5 ppm	Less than .5 ppm	Less than .5 ppm
Iron Fouling	Total Dissolved Solids (TDS)	Less than 1000 ppm	1000-1500 ppm	1000-1500 ppm
	LSI Index	*0.5 to :.05	*0.5 to :.05	*0.5 to :.05
(Biological Growth)	Iron, Fe ²⁺ (Ferrous) Bacterial Iron Potential	< .2ppm	< .2 ppm	< .2 ppm
	Iron Oxide	Less than 1 ppm. Above this level deposition will occur.	Less than 1 ppm. Above this level deposition will occur.	Less than 1 ppm. Above this level deposition will occur.
Erosion	Suspended Solids	Less than 10 ppm and filtered for max of 600 micron size	Less than 10 ppm and filtered for max of 600 micron size	Less than 10 ppm and filtered for max of 600 micron size
	Threshold Velocity (Fresh Water)	< 6 ft/sec	< 6 ft/sec	<6 ft/sec

Vertical Dimensional Data

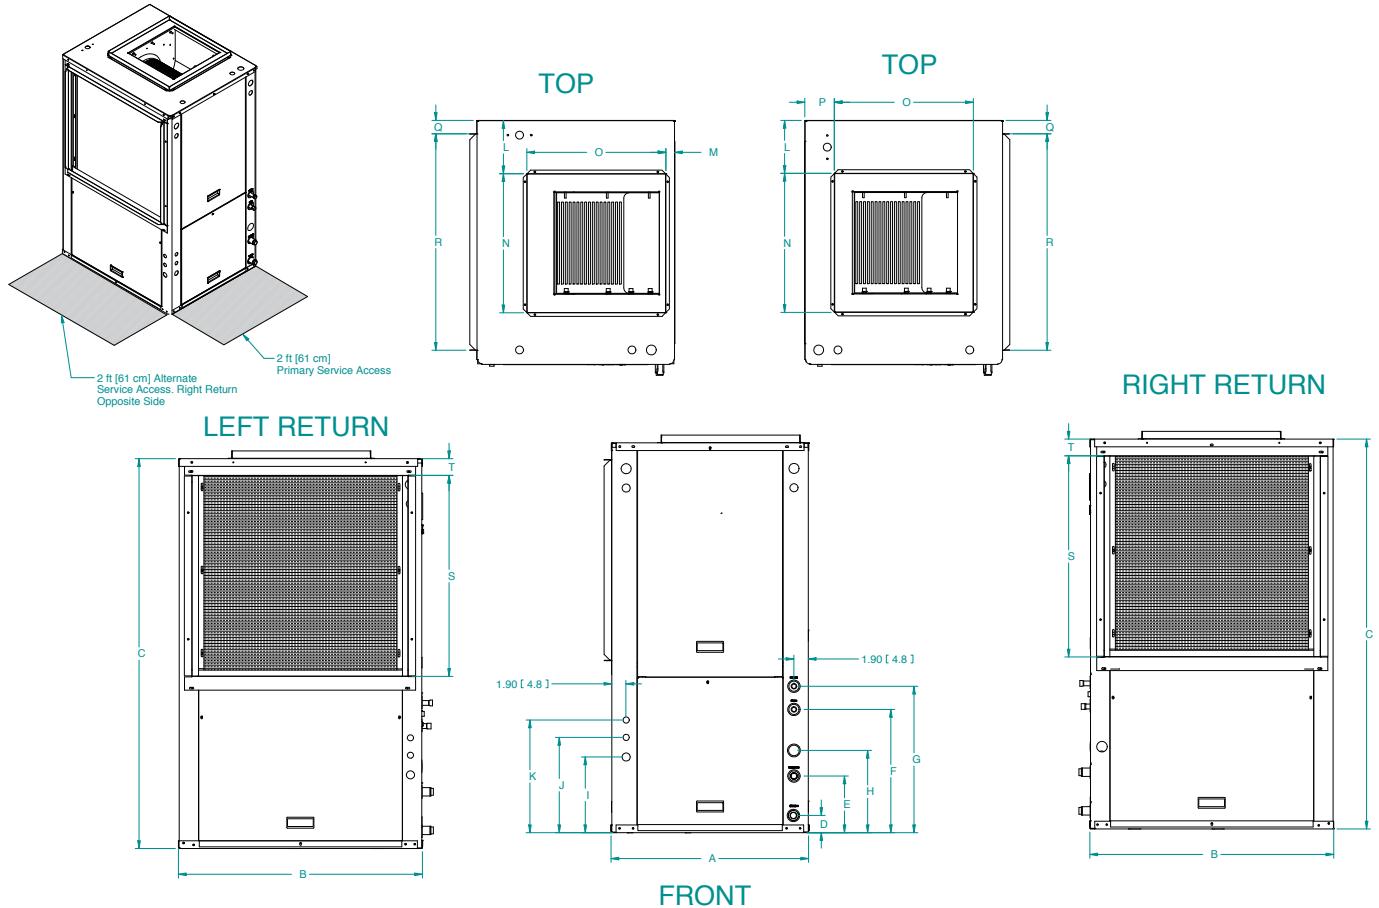

Vertical Top Flow Model		Overall Cabinet			Water Connections						Electrical Connections			Discharge Connection				Return Connection					
		A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	I 3/4" cond	J 1/2" cond	K 1/2" cond	Duct Flange Installed				Return Duct Flanges				
												Power Supply	Ext Pump	Low Voltage	L	M	N	O	P	Q	R	S	T
024	in.	22.5	26.5	39.4	2.3	5.3	13.4	16.4	9.6	1" Swivel	1/2" female	8.9	11.4	13.7	6.3	0.7	14.0	14.0	2.7	2.3	22.0	18.0	1.8
	cm.	57.2	67.3	100.1	5.8	13.5	34.0	41.7	24.4			22.6	29.0	34.8	16.0	1.8	35.6	35.6	6.9	5.8	55.9	45.7	4.6
036	in.	22.5	26.5	44.5	2.0	7.0	13.5	16.5	10.2	1" Swivel	1/2" female	9.5	12.1	14.3	6.1	0.8	14.0	14.0	4.4	2.4	22.0	22.0	2.0
	cm.	57.2	67.3	113.0	5.1	17.8	34.3	41.9	25.9			24.1	30.7	36.3	15.5	2.0	35.6	35.6	11.2	6.1	55.9	55.9	5.1
048- 060	in.	25.6	31.6	50.4	2.3	7.3	15.9	18.9	10.6	1" Swivel	1/2" female	9.8	12.3	14.6	6.9	1.1	18.0	18.0	3.8	1.7	28.0	26.0	1.7
	cm.	65.0	80.3	128.0	5.8	18.5	40.4	48.0	26.9			24.9	31.2	37.1	17.5	2.8	45.7	45.7	9.7	4.3	71.1	66.0	4.3
072	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1" Swivel	1/2" female	9.8	12.3	14.6	6.9	1.1	18.0	18.0	3.8	1.7	28.1	30.0	2.2
	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9			24.9	31.2	37.1	17.5	2.8	45.7	45.7	9.7	4.3	71.4	76.2	5.6

Condensate is 3/4" PVC female glue socket and is switchable from side to front

7/17/14

Unit shipped with 1" [25.4mm] return duct flanges and are suitable for duct connection.



Discharge flange is field installed and extends 1" [25.4mm] from cabinet

Water connections extend 1.2" [30.5mm] beyond front of cabinet.

The optional 1" filter rack (not shown) has the same return opening connection size as the duct flanges shown in the drawing. The filter rack extends 2.25"(57.1 mm) from the unit.

The optional 1" filter rack is suitable for duct connection.

Horizontal Dimensional Data

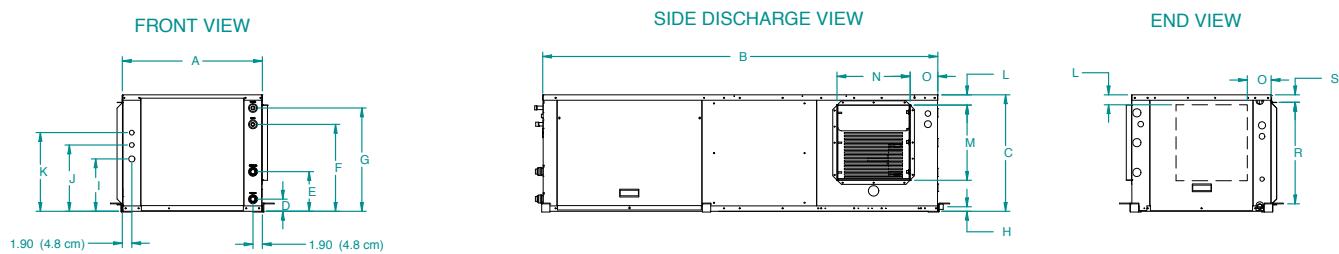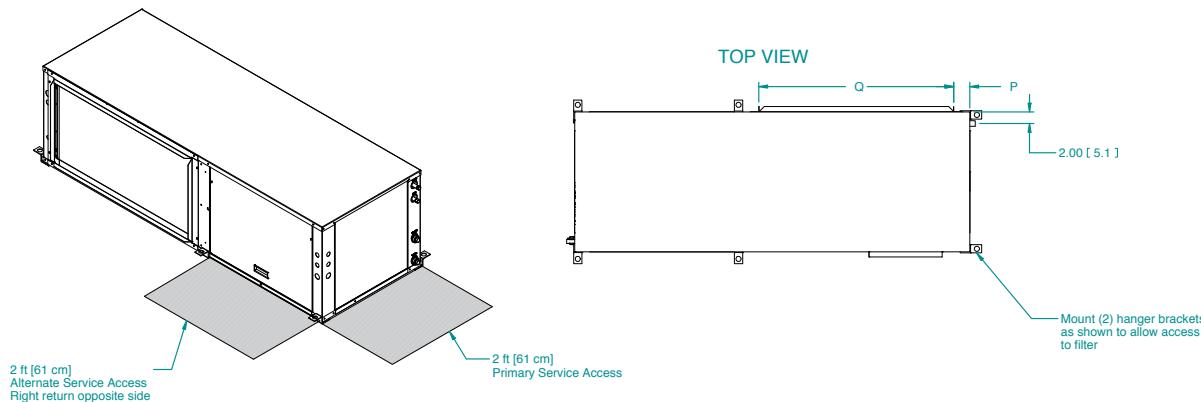

Horizontal Model	Overall Cabinet			Water Connections						Electrical Connections			Discharge Connection			Return Connection						
										I 3/4"	J 1/2"	K 1/2"	Duct Flange Installed			Return Duct Flanges						
	A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	L*	M	N	O*	P	Q	R	S				
	Width	Depth	Height	In	Out	HWG In	HWG Out	Condensate			Power Supply	Ext Pump	Low Voltage	Supply Height	Supply Depth		Return Depth	Return Height				
024	in.	22.5	53.0	19.3	2.3	5.3	13.8	16.8	0.8	1"	1/2"	8.9	11.5	13.7	1.7	10.5	9.5	8.2	2.2	21.8	16.5	1.5
	cm.	57.2	134.6	49.0	5.8	13.5	35.1	42.7	2.0	Swivel	female	22.6	29.2	34.8	4.3	26.7	24.1	20.8	5.6	55.4	41.9	3.8
036	in.	22.5	63.0	19.3	2.3	7.3	13.5	16.5	0.8	1"	1/2"	9.5	12.1	14.3	2.3	10.5	9.5	5.7	2.8	30.5	16.7	1.3
	cm.	57.2	160.0	49.0	5.8	18.5	34.3	41.9	2.0	Swivel	female	24.1	30.7	36.3	5.8	26.7	24.1	14.5	7.1	77.5	42.4	3.3
048-	in.	25.6	72.0	21.3	2.3	7.3	15.9	18.9	0.8	1"	1/2"	9.5	12.1	14.3	1.9	13.6	13.2	5.0	2.9	35.5	18.6	1.3
	cm.	65.0	182.9	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	female	24.1	30.7	36.3	4.8	34.5	33.5	12.7	7.4	90.2	47.2	3.3
072	in.	25.6	77.0	21.3	2.3	7.3	15.9	18.9	0.8	1"	1/2"	9.5	12.1	14.3	1.9	13.6	13.2	5.0	2.8	40.4	18.7	1.5
	cm.	65.0	195.6	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	female	24.1	30.7	36.3	4.8	34.5	33.5	12.7	7.1	102.6	47.5	3.8

* Dimensions shown are for left return side discharge other configurations shown in tables below

7/17/14

Condensate is 3/4" PVC female glue socket and is switchable from side to front

Unit shipped with 1" [25.4mm] return duct flanges suitable for duct connection.

Discharge flange is field installed and extends 1" [25.4mm] from cabinet

Water connections extend 1.2" [30.5mm] beyond front of cabinet.

The optional 1" filter rack (not shown) has the same return opening connection size as the duct flanges shown in the drawing. The filter rack extends 2.25"(57.1 mm) from the unit.

The optional 1" filter rack is suitable for duct connection.

The 024 model is not field convertible changing from end to side discharge. It requires an additional discharge panel (not supplied).

024 model		L	O	036 model		L	O	048-060 model		L	O	072 model		L	O
Right Return End	in	2.2	5.7	Right Return End	in	6.5	6.6	Right Return End	in	1.9	5.0	Right Return End	in	1.9	5.0
Discharge	cm	5.6	14.5	Discharge	cm	16.5	16.8	Discharge	cm	4.8	12.7	Discharge	cm	4.8	12.7
Right Return Side	in	6.9	8.3	Right Return Side	in	2.3	5.7	Right Return Side	in	5.7	5.0	Right Return Side	in	5.7	5.0
Discharge	cm	17.5	21.1	Discharge	cm	5.8	14.5	Discharge	cm	14.5	12.7	Discharge	cm	14.5	12.7
Left Return End	in	6.5	7.3	Left Return End	in	6.5	6.6	Left Return End	in	5.7	4.9	Left Return End	in	5.7	5.0
Discharge	cm	16.5	18.5	Discharge	cm	16.5	16.8	Discharge	cm	14.5	12.4	Discharge	cm	14.5	12.7

Physical Data

Model	Dual Capacity				
	024	036	048	060	072
Compressor (1 each)	Copeland Ultra Tech, Dual Capacity Scroll				
Factory Charge R410a, oz [kg]	Vertical	39 [1.05]	52 [1.47]	68 [1.93]	76 [2.15]
Factory Charge R410a, oz [kg]	Horizontal	38 [1.08]	52 [1.47]	68 [1.93]	72 [2.04]
ECM Blower Motor & Blower					
Blower Motor Type/Speeds	ECM	5 Speed ECM			
Blower Motor- hp [W]	ECM	1/2 [373]	1/2 [373]	1 [746]	1 [746]
Blower Wheel Size (Dia x W), in. [mm]	ECM	9 x 7 [229 x 178]	9 x 7 [229 x 178]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
Coax and Water Piping					
Water Connections Size - Swivel - in [mm]		1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]
HWG Connection Size - Female Sweat I.D. - in [mm]		1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]
Coax & Piping Water Volume - gal [l]		.35 [1.3]	.7 [2.6]	.7 [2.6]	1.3 [4.9]
Vertical					
Air Coil Dimensions (H x W), in. [mm]		19 x 20 [483 x 508]	24 x 20 [610 x 508]	28 x 25 [711 x 635]	28 x 25 [711 x 635]
Air Coil Total Face Area, ft ² [m ²]		2.6 [0.245]	3.3 [0.310]	4.9 [0.452]	4.9 [0.452]
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows		3	3	3	3
Optional Filter - 1" [25mm] Pleated MERV8 Throwaway, in [mm]		20 x 24 [508 x 610]	20 x 24 [508 x 610]	28 x 30 [711 x 762]	28 x 30 [711 x 762]
Weight - Operating, lb [kg]		198 [90]	221 [100]	303 [137]	329 [149]
Weight - Packaged, lb [kg]		218 [99]	241 [109]	323 [147]	349 [158]
Horizontal					
Air Coil Dimensions (H x W), in. [mm]		18 x 21 [457 x 533]	18 x 27 [457 x 686]	20 x 35 [508 x 889]	20 x 35 [508 x 889]
Air Coil Total Face Area, ft ² [m ²]		2.6 [.244]	3.4 [0.314]	4.9 [0.452]	4.9 [0.452]
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows		3	3	3	3
Optional Filter - 1" [25mm] Pleated MERV8 Throwaway, in [mm]		1 - 18 x 24 [457 x 610]	1 - 20 x 32 [508 x 813]	1 - 20 x 37 [508 x 940]	1 - 20 x 37 [508 x 940]
Weight - Operating, lb [kg]		228 [103]	250 [113]	325 [147]	358 [162]
Weight - Packaged, lb [kg]		248 [112]	270 [122]	345 [156]	378 [171]

9/11/2014

Auxiliary Heat Ratings

Model	KW		Stages	BTU/HR		Min CFM			
	208V	230V		208V	230V		024	036	048 - 072
EAM(H)5A	3.6	4.8	1	12,300	16,300	450	●	●	
EAM(H)8A	5.7	7.6	2	19,400	25,900	550	●	●	
EAM(H)10A	7.2	9.6	2	24,600	32,700	650	●	●	
EAL(H)10A	7.2	9.6	2	24,600	32,700	1100			●
EAL(H)15A	10.8	14.4	2	36,900	49,100	1250			●
EAL(H)20A	14.4	19.2	2	49,200	65,500	1500			●

Order the "H" part number when installed on horizontal units

6/9/2014

Air flow level for auxiliary heat (Aux) must be equal to or above the minimum CFM in this table

Auxiliary Heat Electrical Data

Model	Supply Circuit	Heater Amps		Min Circuit Amp		Fuse (USA)		Fuse (CAN)		CKT BRK	
		208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V
EAM(H)5A	Single	17.3	20.0	26.7	30.0	30	30	30	30	30	30
EAM(H)8A	Single	27.5	31.7	39.3	44.6	40	45	40	45	40	45
EAM(H)10A	Single	34.7	40.0	48.3	55.0	50	60	50	60	50	60
EAL(H)10A	Single	34.7	40.0	53.3	60.0	60	60	60	60	60	60
EAL(H)15A	Single	52.0	60.0	75.0	85.0	80	90	80	90	70	100
	L1/L2	34.7	40.0	53.3	60.0	60	60	60	60	60	60
	L3/L4	17.3	20.0	21.7	25.0	25	25	25	25	20	30
EAL(H)20A	Single	69.3	80.0	96.7	110.0	100	110	100	110	100	100
	L1/L2	34.7	40.0	53.3	60.0	60	60	60	60	60	60
	L3/L4	34.7	40.0	43.3	50.0	45	50	45	50	40	50

All heaters rated single phase 60 cycle and include unit fan load

3/10/14

All fuses type "D" time delay (or HACR circuit breaker in USA)

Supply wire size to be determined by local codes

Electrical Data

Dual Capacity Unit with 5 Speed ECM Motor

Model	Rated Voltage	Voltage Min/Max	Compressor				HWG Pump FLA	Ext Loop FLA	Blower Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
			MCC	RLA	LRA	LRA**						
024	208-230/60/1	187/253	18.2	11.6	58.3	21.0	0.4	5.4	4.1	21.5	24.5	35
036	208-230/60/1	187/253	23.8	15.2	83.0	30.0	0.4	5.4	4.1	25.1	28.9	40
048	208-230/60/1	187/253	33.0	21.1	104.0	37.0	0.4	5.4	7.6	34.5	39.8	60
060	208-230/60/1	187/253	42.3	27.1	152.9	54.0	0.4	5.4	7.6	40.5	47.2	70
072	208-230/60/1	187/253	46.3	29.6	179.2	63.0	0.4	5.4	7.6	43.0	50.4	80

**With optional IntelliStart

6/9/14

Rated Voltage of 208/230/60/1

HACR circuit breaker in USA only

All fuses Class RK-5

Blower Performance Data

5-Speed ECM Constant Torque Motors

The 5-Speed ECM is a 'Constant Torque' ECM motor and delivers air flow similar to a PSC but operates as efficiently as an ECM Motor. Because it's an ECM Motor, the 5-Speed ECM can ramp slowly up or down like the ECM motor. There are 5 possible speed taps available on the 5-Speed ECM motor with #1 being the lowest airflow and #5 being the highest airflow. These speed selections are preset at the time of manufacture and are easily changed in the field if necessary.

If more than one tap are energized at the same time, built in logic gives precedence to the highest tap number and allows air flow to change with G, Y1, Y2 and W signals or with Fan, CC, CC2, and E1 output signals. Each of those 5 speeds has a specific 'Torque' value programmed into the motor for each speed selection.

As static pressure increases, airflow decreases resulting in less torque on the rotor. The motor responds only to changes in torque and adjusts its speed accordingly.

The 5-Speed ECM motor is powered by line voltage but the motor speed is energized by 24 VAC.

5-Speed ECM Benefits:

- High efficiency
- Soft start
- 5 speeds with up to 4 speeds on-line
- Built in logic allows air flow to change with G, Y1, Y2 and W signals
- Super efficient low airflow continuous blower setting (G)

Blower Performance Data cont.

Dual Capacity with 5-Speed ECM

Model	Motor Speed	Motor Tap	T'stat Cnct.	Blower Size	Motor HP	Airflow (cfm) at External Static Pressure (in. wg)															
						0	0.05	0.1	0.15	0.2	0.25	0.3	0.35	0.4	0.45	0.5	0.6	0.7	0.8	0.9	1.00
024	High	5	W	9 x 7	1/2	1024	1013	1002	988	974	963	951	940	929	901	872	785	691	-	-	-
	Med High	4	Y2			932	917	902	892	882	867	851	842	832	817	802	756	661	-	-	-
	Med	3				835	826	816	801	785	772	759	749	738	719	700	677	636	-	-	-
	Med Low	2	Y1			765	747	729	720	710	696	681	662	643	627	611	581	515	-	-	-
	Low	1	G			665	656	647	626	605	593	580	561	541	519	496	443	392	-	-	-
036	High	5	W	9 x 7	1/2	1325	1319	1313	1293	1272	1242	1212	1158	1103	1058	1013	930	839	-	-	-
	Med High	4	Y2			1279	1267	1254	1238	1222	1203	1184	1137	1089	1049	1008	926	836	-	-	-
	Med	3				1229	1218	1206	1187	1167	1154	1140	1110	1079	1044	1008	929	829	-	-	-
	Med Low	2	Y1			1201	1184	1167	1156	1145	1129	1113	1086	1058	1028	997	914	808	-	-	-
	Low	1	G			1007	989	971	958	945	925	904	889	873	862	850	818	778	-	-	-
048	High	5	W	11 x 10	1	1890	1874	1857	1845	1833	1809	1784	1769	1754	1736	1718	1672	1629	1601	1562	1522
	Med High	4	Y2			1769	1754	1739	1721	1703	1685	1666	1645	1623	1604	1585	1539	1499	1463	1432	1376
	Med	3				1671	1652	1632	1614	1595	1576	1557	1536	1514	1494	1474	1430	1387	1351	1313	1173
	Med Low	2	Y1			1574	1555	1535	1514	1492	1472	1452	1431	1410	1387	1363	1330	1284	1236	1108	1014
	Low	1	G			1388	1370	1352	1322	1292	1264	1236	1216	1195	1178	1161	1095	984	916	842	787
060	High	5	W	11 x 10	1	2077	2066	2055	2044	2033	2017	2000	1966	1931	1904	1877	1841	1810	1791	1740	1653
	Med High	4	Y2			1948	1937	1925	1910	1895	1880	1865	1831	1797	1778	1759	1720	1707	1680	1660	1612
	Med	3				1810	1794	1778	1739	1700	1684	1667	1657	1646	1629	1612	1576	1583	1547	1510	1480
	Med Low	2	Y1			1680	1667	1653	1618	1583	1562	1540	1522	1503	1488	1473	1465	1449	1410	1369	1319
	Low	1	G			1594	1572	1550	1512	1474	1450	1426	1410	1393	1385	1376	1351	1325	1290	1168	1085
072	High	5	W	11 x 10	1	2402	2388	2373	2358	2343	2334	2325	2307	2289	2274	2258	2215	2177	2125	2052	1933
	Med High	4	Y2			2209	2193	2177	2164	2151	2135	2118	2105	2092	2072	2052	2017	1982	1954	1925	1844
	Med	3				2085	2072	2058	2045	2031	2010	1989	1972	1954	1936	1918	1881	1852	1821	1790	1751
	Med Low	2	Y1			1961	1951	1940	1926	1911	1885	1859	1844	1829	1814	1798	1759	1727	1703	1670	1636
	Low	1	G			1767	1751	1735	1715	1694	1678	1661	1640	1619	1602	1584	1548	1512	1475	1426	1397

Factory speed settings are in Bold

7/30/14

Air flow values are with dry coil and standard filter

For wet coil performance first calculate the face velocity of the air coil (Face Velocity [fpm] = Airflow [cfm] / Face Area [sq ft]).

Then for velocities of 200 fpm reduce the static capability by 0.03 in. wg, 300 fpm by 0.08 in. wg, 400 fpm by 0.12in. wg., and 500 fpm by 0.16 in. wg.

Highest setting is for auxiliary heat (W) and lowest setting is for constant blower (G). The "Y1" and "Y2" settings must be between the "G" and "W" settings.


Setting Blower Speed - 5-Speed ECM

5-Speed ECM blower motors have five (5) speeds of which four (4) are selectable on dual capacity.



CAUTION: Disconnect all power before performing this operation.

5-Speed ECM Motor Connections - Dual Capacity

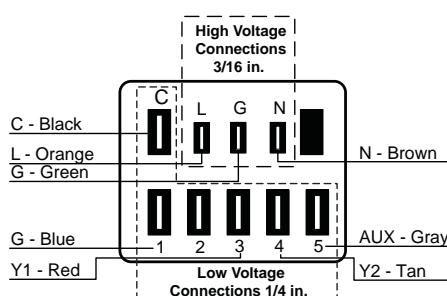

Reference Calculations

Heating Calculations:	Cooling Calculations:
$LWT = EWT - \frac{HE}{gpm \times 500}$	$LWT = EWT + \frac{HR}{gpm \times 500}$
$LAT = EAT + \frac{HC}{cfm \times 1.08}$	$LAT (DB) = EAT (DB) - \frac{SC}{cfm \times 1.08}$
$TH = HC + HW$	$LC = TC - SC$ $S/T = \frac{SC}{TC}$

Legend and Notes

Abbreviations and Definitions

cfm = airflow, cubic feet/minute
 EWT = entering water temperature, Fahrenheit
 gpm = water flow in gallons/minute
 WPD = water pressure drop, psi and feet of water
 EAT = entering air temperature, Fahrenheit (dry bulb/wet bulb)
 HC = air heating capacity, MBtu/h
 TC = total cooling capacity, MBtu/h
 SC = sensible cooling capacity, MBtu/h
 kW = total power unit input, kilowatts
 HR = total heat of rejection, MBtu/h
 HE = total heat of extraction, MBtu/h

HWC = hot water generator capacity, MBtu/h
 EER = Energy Efficient Ratio
 = Btu output/Watt input
 COP = Coefficient of Performance
 = Btu output/Btu input
 LWT = leaving water temperature, °F
 LAT = leaving air temperature, °F
 TH = total heating capacity, MBtu/h
 LC = latent cooling capacity, MBtu/h
 S/T = sensible to total cooling ratio

Notes to Performance Data Tables

The following notes apply to all performance data tables:

- Performance ratings are based on 80°F DB/67°F WB EAT for cooling and 70°F DB EAT for heating.
- Three flow rates are shown for each unit. The lowest flow rate shown is used for geothermal open loop/well water systems with a minimum of 50°F EWT. The middle flow rate shown is the minimum geothermal closed loop flow rate. The highest flow rate shown is optimum for geothermal closed loop systems and the suggested flow rate for boiler/tower applications.
- The hot water generator numbers are based on a flow rate of 0.4 gpm/ton of rated capacity with an EWT of 90°F.
- Entering water temperatures below 40°F assumes 15% antifreeze solution.
- For non-standard EAT conditions, apply the appropriate Correction Factor tables.
- Interpolation between EWT, gpm, and cfm data is permissible, extrapolation is not.

Operating Limits

Operating Limits	Cooling		Heating	
	(°F)	(°C)	(°F)	(°C)
Air Limits				
Min. Ambient Air	45	7.2	45	7.2
Rated Ambient Air	80	26.7	70	21.1
Max. Ambient Air	100	37.8	85	29.4
Min. Entering Air	50	10.0	40	4.4
Rated Entering Air db/wb	80.6/66.2	27/19	68	20.0
Max. Entering Air db/wb	110/83	43/28.3	80	26.7
Water Limits				
Min. Entering Water	30	-1.1	20	-6.7
Normal Entering Water	50-110	10-43.3	30-70	-1.1
Max. Entering Water	120	48.9	90	32.2

Notes: Minimum/maximum limits are only for start-up conditions, and are meant for bringing the space up to occupancy temperature. Units are not designed to operate at the minimum/maximum conditions on a regular basis. The operating limits are dependent upon three primary factors: 1) water temperature, 2) return air temperature, and 3) ambient temperature. When any of the factors are at the minimum or maximum levels, the other two factors must be at the normal level for proper and reliable unit operation.

Antifreeze Corrections

Catalog performance can be corrected for antifreeze use. Please use the following table and note the example given.

Antifreeze Type	Antifreeze % by wt	Heating	Cooling	Pressure Drop
EWT - °F [°C]		30 [-1.1]	90 [32.2]	30 [-1.1]
Water	0	1.000	1.000	1.000
Ethylene Glycol	10	0.973	0.991	1.075
	20	0.943	0.979	1.163
	30	0.917	0.965	1.225
	40	0.890	0.955	1.324
	50	0.865	0.943	1.419
Propylene Glycol	10	0.958	0.981	1.130
	20	0.913	0.969	1.270
	30	0.854	0.950	1.433
	40	0.813	0.937	1.614
	50	0.770	0.922	1.816
Ethanol	10	0.927	0.991	1.242
	20	0.887	0.972	1.343
	30	0.856	0.947	1.383
	40	0.815	0.930	1.523
	50	0.779	0.911	1.639
Methanol	10	0.957	0.986	1.127
	20	0.924	0.970	1.197
	30	0.895	0.951	1.235
	40	0.863	0.936	1.323
	50	0.833	0.920	1.399



WARNING: Gray area represents antifreeze concentrations greater than 35% by weight and should be avoided due to the extreme performance penalty they represent.

Antifreeze Correction Example

Antifreeze solution is Propylene Glycol 20% by weight. Determine the corrected heating and cooling performance at 30°F and 90°F respectively as well as pressure drop at 30°F for a 036.

The corrected cooling capacity at 90°F would be: $34,800 \text{ MBtu/h} \times 0.969 = 33,721 \text{ MBtu/h}$

The corrected heating capacity at 30°F would be: $29,300 \text{ MBtu/h} \times 0.913 = 26,750 \text{ MBtu/h}$

The corrected pressure drop at 30°F and 9 gpm would be: $13.4 \text{ feet of head} \times 1.270 = 17.02 \text{ feet of head}$

Correction Factor Tables

Air Flow Corrections (Dual Capacity Part Load)

Airflow		Cooling				Heating		
cfm Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.922	0.778	0.956	0.924	0.943	1.239	0.879
275	69	0.944	0.830	0.962	0.944	0.958	1.161	0.914
300	75	0.957	0.866	0.968	0.958	0.968	1.115	0.937
325	81	0.970	0.900	0.974	0.970	0.977	1.075	0.956
350	88	0.982	0.933	0.981	0.980	0.985	1.042	0.972
375	94	0.991	0.968	0.991	0.991	0.993	1.018	0.988
400	100	1.000						
425	106	1.007	1.033	1.011	1.008	1.007	0.990	1.010
450	113	1.013	1.065	1.023	1.015	1.012	0.987	1.018
475	119	1.017	1.099	1.037	1.022	1.018	0.984	1.025
500	125	1.020	1.132	1.052	1.027	1.022	0.982	1.031
520	130	1.022	1.159	1.064	1.030	1.025	0.979	1.034

5/30/06

Air Flow Corrections (Dual Capacity Full Load and Single Speed)

Airflow		Cooling				Heating		
cfm Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.922	0.786	0.910	0.920	0.943	1.150	0.893
275	69	0.944	0.827	0.924	0.940	0.958	1.105	0.922
300	75	0.959	0.860	0.937	0.955	0.968	1.078	0.942
325	81	0.971	0.894	0.950	0.967	0.977	1.053	0.959
350	88	0.982	0.929	0.964	0.978	0.985	1.031	0.973
375	94	0.992	0.965	0.982	0.990	0.993	1.014	0.988
400	100	1.000						
425	106	1.007	1.034	1.020	1.010	1.007	0.990	1.011
450	113	1.012	1.065	1.042	1.018	1.013	0.983	1.020
475	119	1.017	1.093	1.066	1.026	1.018	0.980	1.028
500	125	1.019	1.117	1.092	1.033	1.023	0.978	1.034
520	130	1.020	1.132	1.113	1.038	1.026	0.975	1.038

Cooling Capacity Corrections

Entering Air WB °F	Total Clg Cap	Sensible Cooling Capacity Multipliers - Entering DB °F										Power Input	Heat of Rejection
		60	65	70	75	80	80.6	85	90	95	100		
55	0.898	0.723	0.866	1.048	1.185	*	*	*	*	*	*	0.985	0.913
60	0.912		0.632	0.880	1.078	1.244	1.260	*	*	*	*	0.994	0.927
63	0.945			0.768	0.960	1.150	1.175	*	*	*	*	0.996	0.954
65	0.976			0.694	0.881	1.079	1.085	1.270	*	*	*	0.997	0.972
66.2	0.983			0.655	0.842	1.040	1.060	1.232	*	*	*	0.999	0.986
67	1.000			0.616	0.806	1.000	1.023	1.193	1.330	1.480	*	1.000	1.000
70	1.053				0.693	0.879	0.900	1.075	1.205	1.404	*	1.003	1.044
75	1.168					0.687	0.715	0.875	1.040	1.261	1.476	1.007	1.141

NOTE: * Sensible capacity equals total capacity at conditions shown.

3/28/12

Heating Capacity Corrections

Ent Air DB °F	Heating Corrections		
	Htg Cap	Power	Heat of Ext
45	1.062	0.739	1.158
50	1.050	0.790	1.130
55	1.037	0.842	1.096
60	1.025	0.893	1.064
65	1.012	0.945	1.030
68	1.005	0.976	1.012
70	1.000	1.000	1.000
75	0.987	1.048	0.970
80	0.975	1.099	0.930

11/10/09

Pressure Drop

Model	GPM	Pressure Drop (psi)				
		30°F	50°F	70°F	90°F	110°F
024 Full Load	4	2.3	2.1	2.0	1.9	1.7
	6	4.5	4.3	4.0	3.7	3.5
	8	7.5	7.0	6.6	6.1	5.7
	10	10.5	9.7	9.9	8.5	7.9
024 Part Load	3	1.5	1.4	1.3	1.2	1.1
	5	3.3	3.1	2.9	2.7	2.5
	7	5.9	5.6	5.2	4.8	4.5
	9	8.5	8.1	8.2	6.9	6.5
036 Full Load	5	1.9	1.8	1.7	1.6	1.5
	7	3.6	3.4	3.2	3.0	2.9
	9	5.8	5.4	5.1	4.8	4.6
	11	8.0	7.4	7.4	6.6	6.3
036 Part Load	4	1.4	1.3	1.2	1.2	1.0
	6	2.7	2.6	2.4	2.3	2.1
	8	4.7	4.4	4.1	4.0	3.5
	10	6.7	6.2	6.2	5.7	4.9
048 Full Load	6	1.7	1.6	1.5	1.4	1.3
	9	3.9	3.6	3.4	3.2	3.1
	12	7.0	6.6	6.2	5.8	5.6
	15	10.1	9.6	9.8	8.4	8.1
048 Part Load	5	1.1	1.1	1.0	0.9	0.9
	8	3.1	2.9	2.7	2.5	2.3
	11	5.9	5.6	5.2	4.8	4.5
	14	8.7	8.3	8.5	7.1	6.7
060 Full Load	8	2.8	2.7	2.5	2.3	2.2
	12	5.8	5.4	5.1	4.8	4.4
	16	9.8	9.2	8.6	8.0	7.4
	20	13.8	13.0	13.0	11.2	10.4
060 Part Load	6	1.7	1.6	1.5	1.4	1.3
	10	4.2	4.0	3.7	3.4	3.2
	14	7.6	7.2	6.7	6.2	5.8
	18	11.0	10.4	10.7	9.0	8.4
072 Full Load	12	3.8	3.6	3.4	3.1	2.9
	15	5.7	5.3	5.0	4.7	4.3
	18	7.8	7.4	6.9	6.4	6.0
	21	9.9	9.5	9.1	8.1	7.7
072 Part Load	10	2.8	2.7	2.5	2.3	2.2
	13	4.4	4.2	3.9	3.6	3.4
	16	6.4	6.0	5.6	5.2	4.8
	19	8.4	7.8	7.6	6.8	6.2

7/18/14

Performance Data cont.

024 - Full Load Dual Capacity with 5-Speed ECM (800 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	4.0	2.3	5.4	Operation not recommended							Operation not recommended							
	6.0	4.7	10.8															
	8.0	7.7	17.8	600	16.0	1.47	10.9	94.6	3.19	2.1	800	16.5	1.51	11.3	89.1	3.19	2.0	
30	4.0	2.3	5.3	Operation not recommended							Operation not recommended							
	6.0	4.5	10.5	600	18.3	1.51	13.2	98.3	3.56	2.3	800	24.7	17.0	0.69	1.00	28.1	24.7	-
	8.0	7.5	17.3	600	18.9	1.56	13.5	91.8	3.55	2.1	800	25.1	18.6	0.74	1.05	28.7	23.8	-
				600	18.6	1.52	13.4	98.8	3.58	2.3	800	24.8	17.0	0.69	0.97	28.1	25.6	-
40	4.0	2.2	5.1	Operation not recommended							Operation not recommended							
	6.0	4.4	10.2	600	20.9	1.58	15.5	102.2	3.86	2.5	800	25.0	17.2	0.69	1.10	28.7	22.7	-
				800	21.5	1.62	16.0	94.9	3.90	2.3	800	25.4	18.8	0.74	1.15	29.4	22.1	-
	8.0	7.3	16.8	600	21.3	1.60	15.8	102.9	3.90	2.6	800	25.2	17.2	0.68	1.07	28.8	23.6	-
50	4.0	2.1	4.9	600	22.6	1.62	17.1	104.9	4.09	2.7	800	24.0	15.8	0.66	1.26	28.3	19.1	1.1
				800	23.3	1.64	17.7	96.9	4.15	2.5	800	25.2	17.6	0.70	1.32	29.8	19.1	1.2
	6.0	4.3	9.9	600	23.4	1.66	17.8	106.2	4.14	2.8	800	24.5	16.0	0.65	1.19	28.5	20.7	1.0
	8.0	7.0	16.3	600	24.2	1.68	18.4	98.0	4.22	2.6	800	25.8	17.8	0.69	1.24	30.0	20.7	1.2
60	4.0	2.1	4.8	600	24.0	1.67	18.2	107.0	4.20	2.9	800	24.7	17.1	0.69	1.16	28.7	21.4	1.0
				800	24.7	1.69	18.9	98.6	4.27	2.6	800	26.0	19.0	0.73	1.22	30.2	21.4	1.1
	6.0	4.1	9.6	600	24.7	1.68	19.0	108.2	4.32	3.0	800	23.4	15.7	0.67	1.37	28.1	17.1	1.3
	8.0	6.8	15.8	600	25.5	1.69	19.8	99.5	4.43	2.8	800	24.6	17.5	0.71	1.43	29.5	17.1	1.4
70	4.0	2.0	4.6	600	25.8	1.73	20.0	109.9	4.39	3.0	800	24.0	15.9	0.66	1.30	28.4	18.4	1.2
				800	26.7	1.74	20.8	100.9	4.50	2.8	800	25.1	17.7	0.70	1.36	29.8	18.5	1.4
	6.0	4.0	9.2	600	26.5	1.74	20.5	110.8	4.45	3.2	800	24.2	16.8	0.69	1.27	28.6	19.0	1.1
	8.0	6.6	15.3	600	27.3	1.75	21.4	101.6	4.58	2.9	800	25.4	18.6	0.73	1.33	30.0	19.1	1.3
80	4.0	2.0	4.6	600	26.9	1.74	21.0	111.5	4.54	3.2	800	22.9	15.6	0.68	1.49	28.0	15.4	1.6
				800	27.8	1.74	21.9	102.2	4.69	3.0	800	23.9	17.4	0.73	1.54	29.2	15.5	1.7
	6.0	4.0	9.2	600	28.3	1.79	22.1	113.6	4.62	3.4	800	23.5	15.8	0.67	1.42	28.4	16.5	1.5
	8.0	6.6	15.3	600	29.2	1.79	23.1	103.8	4.77	3.1	800	24.5	17.5	0.72	1.47	29.5	16.6	1.7
90	4.0	1.9	4.5	600	31.4	1.89	25.0	118.5	4.87	3.9	800	22.8	16.1	0.70	1.54	28.0	14.8	1.8
				800	32.5	1.87	26.1	107.6	5.11	3.6	800	23.7	17.8	0.75	1.59	29.1	14.9	2.0
	6.0	3.9	8.9	600	30.9	1.86	24.6	117.7	4.87	3.9	800	21.0	15.3	0.73	1.78	27.0	11.8	2.5
	8.0	6.4	14.7	600	32.0	1.83	25.8	107.0	5.12	3.7	800	22.8	17.2	0.75	1.68	28.5	13.5	2.1
100	4.0	1.9	4.3	600	32.8	1.94	26.2	120.7	4.95	4.1	800	21.6	15.5	0.72	1.73	27.5	12.5	2.4
				800	34.0	1.91	27.5	109.4	5.22	3.8	800	22.4	17.2	0.77	1.77	28.4	12.6	2.6
	6.0	3.7	8.6	600	33.9	1.97	27.2	122.3	5.04	4.3	800	21.8	15.6	0.72	1.70	27.6	12.8	2.2
	8.0	6.1	14.2	800	35.0	1.92	28.5	110.6	5.34	4.0	800	22.6	17.3	0.77	1.74	28.5	13.0	2.5
110	4.0	1.8	4.2	Operation not recommended							Operation not recommended							
											600	20.4	15.2	0.75	1.92	26.9	10.6	2.9
	6.0	3.6	8.3								800	21.1	16.9	0.80	1.95	27.7	10.8	3.2
	8.0	5.9	13.7								600	20.6	15.2	0.74	1.88	27.0	10.9	2.7
120	4.0	1.7	4.0	Operation not recommended							Operation not recommended							
											600	19.2	15.0	0.78	2.11	26.4	9.1	3.7
	6.0	3.5	8.0								800	19.8	16.6	0.84	2.12	27.0	9.3	4.0
	8.0	5.7	13.2								600	19.4	14.8	0.76	2.07	26.5	9.4	3.4
120	4.0	1.7	3.8	Operation not recommended							Operation not recommended							
											600	17.4	14.4	0.83	2.31	25.3	7.5	4.3
	6.0	3.3	7.7								800	17.7	15.7	0.88	2.37	25.8	7.5	4.7
	8.0	5.5	12.7								600	17.5	14.4	0.82	2.23	25.2	7.9	4.0
											800	17.9	15.7	0.87	2.31	25.8	7.8	4.4

Performance capacities shown in thousands of Mbtu/h.

7/18/14

Performance Data cont.

024 - Part Load Dual Capacity with 5-Speed ECM (600 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F						COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER
20	3.0	1.5	3.5	Operation not recommended							Operation not recommended						
	5.0	3.4	7.8														
	7.0	6.1	14.1	500	11.6	1.17	7.6	91.4	2.89	1.8	600	12.0	1.20	7.9	88.6	2.93	1.7
30	3.0	1.5	3.4	Operation not recommended							Operation not recommended						
	5.0	3.3	7.6	500	12.7	1.16	8.8	93.6	3.22	1.7	600	17.7	12.6	0.71	0.64	19.9	27.7
	7.0	5.9	13.7	600	13.3	1.19	9.2	90.5	3.27	1.6	500	18.0	13.7	0.76	0.67	20.3	26.7
40	3.0	1.4	3.3	Operation not recommended							Operation not recommended						
	5.0	3.2	7.4	500	14.8	1.18	10.8	97.4	3.68	1.7	600	18.0	12.7	0.71	0.71	20.4	25.3
	7.0	5.7	13.2	600	15.3	1.20	11.2	93.7	3.73	1.6	500	18.3	13.9	0.76	0.75	20.9	24.5
50	3.0	1.4	3.2	Operation not recommended							Operation not recommended						
	5.0	3.1	7.2	500	15.6	1.21	11.5	98.9	3.78	1.8	600	18.1	12.7	0.70	0.69	20.5	26.2
	7.0	5.6	12.8	600	16.1	1.23	11.9	94.9	3.84	1.7	600	18.2	13.7	0.75	0.65	20.5	28.0
60	3.0	1.3	3.1	Operation not recommended							Operation not recommended						
	5.0	3.0	6.9	500	16.3	1.20	12.2	100.2	3.97	1.8	600	17.8	12.3	0.69	0.80	20.6	22.2
	7.0	5.4	12.4	600	16.8	1.22	12.6	95.9	4.04	1.7	500	18.3	13.6	0.74	0.82	21.1	22.4
70	3.0	1.3	3.0	Operation not recommended							Operation not recommended						
	5.0	2.9	6.7	500	19.1	1.23	14.9	105.3	4.55	2.0	600	17.5	12.1	0.69	0.88	20.5	19.9
	7.0	5.2	12.0	600	19.5	1.23	15.3	100.1	4.63	1.9	500	18.0	13.3	0.74	0.90	21.0	20.0
80	3.0	1.3	2.9	Operation not recommended							Operation not recommended						
	5.0	2.8	6.5	500	22.4	1.28	18.0	111.4	5.11	2.5	600	16.0	11.4	0.71	1.13	19.9	14.2
	7.0	5.0	11.6	600	22.7	1.28	18.3	105.0	5.21	2.2	500	16.5	12.6	0.76	1.16	20.4	14.3
90	3.0	1.2	2.8	Operation not recommended							Operation not recommended						
	5.0	2.7	6.2	500	24.4	1.31	19.9	115.1	5.45	2.8	600	15.3	11.0	0.72	1.26	19.6	12.1
	7.0	4.8	11.2	600	24.6	1.29	20.1	107.9	5.56	2.5	500	15.7	12.2	0.78	1.29	20.1	12.2
100	3.0	1.2	2.7	Operation not recommended							Operation not recommended						
	5.0	2.6	6.0	500	25.6	1.30	21.2	117.4	5.78	2.9	600	14.7	11.1	0.75	1.39	19.4	10.6
	7.0	4.7	10.8	600	25.8	1.28	21.4	109.8	5.90	2.6	500	15.1	12.3	0.81	1.41	19.9	2.4
110	3.0	1.1	2.6	Operation not recommended							Operation not recommended						
	5.0	2.5	5.8	500	23.4	1.28	19.1	113.4	5.39	2.5	600	13.5	10.5	0.78	1.57	18.9	8.7
	7.0	4.5	10.4	600	23.7	1.27	19.4	106.6	5.49	2.3	500	13.9	11.7	0.74	1.60	19.4	3.3
120	3.0	1.1	2.5	Operation not recommended							Operation not recommended						
	5.0	2.4	5.6	500	25.7	1.32	21.2	117.6	5.70	2.9	600	12.6	10.5	0.82	1.72	18.6	7.4
	7.0	4.3	10.0	600	25.8	1.30	21.4	109.9	5.81	2.6	600	13.0	11.4	0.88	1.77	19.0	3.8

Performance capacities shown in thousands of Mbtu/h.

7/18/14

Performance Data cont.

036 - Full Load Dual Capacity with 5-Speed ECM (1200 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F						
		PSI	FT	Airflow cfm	HC MBtu/h	Power kW	HE MBtu/h	LAT °F	COP	HWC MBtu/h	Airflow cfm	TC MBtu/h	SC MBtu/h	S/T Ratio	Power kW	HR MBtu/h	EER
20	5.0	2.0	4.6	Operation not recommended							Operation not recommended						
	7.0	3.7	8.7														
	9.0	6.0	13.8	1000	24.4	2.27	16.6	92.6	3.15	3.3	1200	25.2	2.34	17.2	89.4	3.16	3.0
30	5.0	1.9	4.5	Operation not recommended							Operation not recommended						
	7.0	3.6	8.4	1000	27.9	2.32	20.0	95.8	3.53	3.5	1000	34.1	21.8	0.64	1.58	39.5	21.7
	9.0	5.8	13.4	1200	28.7	2.39	20.5	92.1	3.52	3.2	1200	34.7	23.9	0.69	1.66	40.3	20.9
40	5.0	1.9	4.3	Operation not recommended							Operation not recommended						
	7.0	3.5	8.2	1000	31.6	2.43	23.3	99.3	3.81	3.8	1000	36.2	24.0	0.66	1.73	42.1	20.9
	9.0	5.6	13.0	1200	32.6	2.48	24.1	95.2	3.85	3.5	1200	36.9	26.1	0.71	1.81	43.1	20.3
50	5.0	1.8	4.2	1000	34.1	2.49	25.7	101.6	4.02	4.1	1000	36.3	23.7	0.65	1.97	43.1	18.4
	7.0	3.4	7.9	1200	35.2	2.52	26.6	97.1	4.08	3.8	1200	38.2	26.3	0.69	2.08	45.3	18.4
	9.0	5.4	12.6	1000	35.4	2.55	26.7	102.8	4.07	4.2	1000	37.1	24.0	0.65	1.86	43.5	20.0
60	5.0	1.8	4.1	1000	36.5	2.58	27.7	98.2	4.15	3.9	1200	39.0	26.6	0.68	1.95	45.7	20.0
	7.0	3.3	7.6	1200	36.2	2.57	27.4	103.5	4.13	4.4	1000	37.5	25.6	0.68	1.81	43.7	20.7
	9.0	5.3	12.2	1000	37.3	2.60	28.4	98.8	4.20	4.0	1200	39.5	28.4	0.72	1.90	46.0	20.7
70	5.0	1.7	3.9	1000	37.5	2.59	28.6	104.7	4.24	4.6	1000	35.8	24.1	0.67	2.14	43.1	16.7
	7.0	3.2	7.4	1200	38.7	2.61	29.8	99.9	4.35	4.2	1200	37.5	26.8	0.71	2.24	45.2	16.8
	9.0	5.1	11.8	1000	39.2	2.67	30.1	106.3	4.31	4.7	1000	36.6	24.4	0.67	2.04	43.6	18.0
80	5.0	1.6	3.8	1000	40.4	2.68	31.3	101.2	4.42	4.4	1200	38.4	27.0	0.70	2.12	45.6	18.1
	7.0	3.1	7.1	1200	40.1	2.69	30.9	107.2	4.36	4.9	1000	37.0	25.7	0.69	1.99	43.8	18.6
	9.0	4.9	11.4	1000	41.4	2.71	32.2	102.0	4.49	4.5	1200	38.8	28.5	0.73	2.08	45.9	18.7
90	5.0	1.7	3.9	1000	40.9	2.70	31.7	107.8	4.44	5.1	1000	35.2	24.5	0.69	2.32	43.1	15.2
	7.0	3.2	7.4	1200	42.3	2.70	33.1	102.6	4.60	4.7	1200	36.8	27.2	0.74	2.40	45.0	15.3
	9.0	5.1	11.8	1000	43.0	2.78	33.5	109.8	4.52	5.3	1000	36.1	24.8	0.69	2.22	43.7	16.3
100	5.0	1.6	3.8	1000	44.1	2.82	34.5	110.8	4.59	5.8	1000	33.7	24.3	0.72	2.53	42.3	13.3
	7.0	2.9	6.6	1200	45.7	2.80	36.1	105.2	4.79	5.4	1200	35.1	27.1	0.77	2.60	43.9	13.5
	9.0	4.6	10.6	1000	46.7	2.93	36.7	113.2	4.67	6.0	1000	34.6	24.6	0.71	2.44	43.0	14.2
110	5.0	1.5	3.4	1000	48.0	2.97	37.9	114.4	4.74	6.2	1000	35.0	25.3	0.72	2.39	43.2	14.7
	7.0	2.8	6.4	1200	49.6	2.92	39.7	108.3	4.98	5.7	1200	36.5	28.0	0.77	2.46	44.8	14.8
	9.0	4.8	11.0	1000	49.0	3.04	41.3	118.1	4.88	7.0	1000	33.5	24.8	0.74	2.62	42.5	12.8
120	5.0	1.4	3.3	1000	50.3	3.07	39.9	116.6	4.80	6.8	1200	34.8	27.4	0.79	2.67	43.9	13.0
	7.0	2.7	6.1	1200	51.9	3.12	41.3	111.4	5.18	6.5	1000	32.2	24.2	0.75	2.74	41.5	11.8
	9.0	4.2	9.8	1000	53.7	3.04	43.3	111.4	5.18	6.5	1200	34.8	27.4	0.79	2.67	43.9	13.0

Performance capacities shown in thousands of Mbtu/h.

7/18/14

Performance Data cont.

036 - Part Load Dual Capacity with 5-Speed ECM (1000 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	4.0	1.4	3.2	Operation not recommended							Operation not recommended							
	6.0	2.8	6.5															
	8.0	4.8	11.1	850	17.1	1.74	11.1	88.6	2.87	2.9	850	25.8	16.5	0.64	0.96	29.1	26.8	-
				1000	17.8	1.79	11.7	86.5	2.91	2.6	1000	26.2	18.1	0.69	1.01	29.7	25.8	-
30	4.0	1.4	3.2	Operation not recommended							Operation not recommended							
	6.0	2.7	6.3															
	8.0	4.7	10.8	850	18.6	1.72	12.8	90.3	3.17	2.8	850	25.9	16.5	0.64	0.93	29.1	27.7	-
				1000	19.4	1.77	13.4	88.0	3.22	2.5	1000	26.6	18.1	0.68	0.98	29.9	27.1	-
40	4.0	1.3	3.1	Operation not recommended							Operation not recommended							
	6.0	2.6	6.1															
	8.0	4.5	10.4	850	21.8	1.75	15.8	93.7	3.64	2.8	1000	28.3	20.6	0.73	1.11	32.1	25.4	-
				1000	22.6	1.79	16.5	90.9	3.70	2.6	850	28.0	18.9	0.68	1.03	31.5	27.1	-
50	4.0	1.3	3.0	Operation not recommended							Operation not recommended							
	6.0	2.6	5.9															
	8.0	4.4	10.1	850	24.1	1.79	18.0	96.2	3.95	3.0	1000	29.8	22.4	0.75	1.22	34.0	24.5	1.0
				1000	24.8	1.81	18.7	93.0	4.02	2.7	850	29.3	20.4	0.70	1.16	33.3	25.2	0.9
60	4.0	1.2	2.9	Operation not recommended							Operation not recommended							
	6.0	2.5	5.7															
	8.0	4.2	9.8	850	27.3	1.83	21.1	99.7	4.38	3.2	1000	28.0	19.8	0.71	1.34	32.6	20.9	1.3
				1000	28.0	1.84	21.7	95.9	4.46	3.0	850	28.8	21.9	0.76	1.37	33.4	21.0	1.4
70	4.0	1.2	2.8	Operation not recommended							Operation not recommended							
	6.0	2.4	5.5															
	8.0	4.1	9.5	850	31.8	1.86	25.5	104.7	5.02	3.7	1000	27.2	19.4	0.72	1.45	32.1	18.7	1.6
				1000	32.4	1.86	26.1	100.0	5.11	3.4	850	27.9	21.5	0.77	1.48	33.0	18.9	1.7
80	4.0	1.2	2.7	Operation not recommended							Operation not recommended							
	6.0	2.3	5.4															
	8.0	4.0	9.2	850	34.0	1.91	27.4	107.0	5.21	4.1	1000	25.7	19.1	0.74	1.69	31.5	15.2	2.3
				1000	34.4	1.90	27.9	101.9	5.31	3.8	850	26.4	21.1	0.80	1.72	32.3	15.4	2.5
90	4.0	1.1	2.6	Operation not recommended							Operation not recommended							
	6.0	2.2	5.2															
	8.0	3.8	8.8	850	37.4	1.96	30.8	110.8	5.60	4.7	1000	24.5	18.9	0.77	1.89	30.9	13.0	3.2
				1000	37.7	1.93	31.1	104.9	5.72	4.4	850	25.2	20.9	0.83	1.92	31.7	13.1	3.4
100	4.0	1.1	2.5	Operation not recommended							Operation not recommended							
	6.0	2.2	5.0															
	8.0	3.7	8.5	850	23.0	18.4	20.3	21.4	0.80	2.08	1000	23.7	20.3	0.86	2.12	30.9	11.2	4.1
				1000	23.4	18.8	20.6	21.3	0.80	1.68	850	24.7	19.0	0.77	1.84	31.0	13.4	3.0
110	4.0	1.0	2.4	Operation not recommended							Operation not recommended							
	6.0	2.1	4.8															
	8.0	3.5	8.2	850	21.4	17.8	19.7	20.7	0.89	2.37	1000	22.0	19.7	0.89	2.30	29.6	9.4	4.6
				1000	21.7	18.2	19.0	20.4	0.84	2.30	850	22.3	20.2	0.90	2.35	30.4	9.5	5.1
120	4.0	1.0	2.3	Operation not recommended							Operation not recommended							
	6.0	2.0	4.6															
	8.0	3.4	7.9	850	19.8	17.9	19.0	20.4	0.90	2.63	1000	20.1	19.4	0.96	2.70	29.4	7.5	6.4
				1000	20.0	17.9	19.3	20.4	0.90	2.55	850	20.4	19.4	0.95	2.63	28.7	7.8	5.5

Performance capacities shown in thousands of Mbtu/h.

7/18/14

Performance Data cont.

048 - Full Load Dual Capacity with 5-Speed ECM High Speed (1700 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow cfm	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	6.0	1.8	4.1	Operation not recommended							Operation not recommended							
	9.0	4.0	9.2															
	12.0	7.3	16.8	1400	31.6	2.98	21.4	90.9	3.10	5.6	1700	32.7	3.03	22.4	87.8	3.17	5.1	1700
30	6.0	1.7	3.9	Operation not recommended							Operation not recommended							
	9.0	3.9	8.9	1400	35.0	3.02	24.7	93.1	3.39	5.7	1400	47.5	30.0	0.63	2.08	54.6	22.8	-
	12.0	7.0	16.3	1700	36.1	3.04	25.7	89.6	3.47	5.3	1700	48.3	32.7	0.68	2.19	55.8	22.0	-
40	6.0	1.7	3.8	Operation not recommended							Operation not recommended							
	9.0	3.7	8.7	1400	39.5	3.13	28.9	96.1	3.71	6.3	1400	50.0	32.6	0.65	2.28	57.8	22.0	-
	12.0	6.8	15.8	1700	40.9	3.13	30.3	92.3	3.84	5.8	1700	51.0	35.6	0.70	2.39	59.1	21.3	-
50	6.0	1.6	3.7	1400	40.9	3.13	30.3	97.1	3.83	6.6	1400	51.2	32.5	0.64	2.92	61.1	17.5	3.0
	9.0	3.6	8.4	1700	42.2	3.13	31.6	93.0	3.96	6.1	1700	52.8	38.4	0.73	3.04	63.2	17.3	3.1
	12.0	6.6	15.3	1400	44.1	3.23	33.1	99.2	4.00	7.0	1400	52.3	32.7	0.63	2.53	60.9	20.7	2.8
60	6.0	1.6	3.6	1400	45.8	3.25	34.9	95.0	4.18	6.5	1700	53.9	38.5	0.72	2.65	62.9	20.3	3.0
	9.0	3.5	8.1	1700	45.8	3.25	34.7	100.3	4.13	7.4	1400	52.6	32.7	0.62	2.38	60.7	22.1	2.6
	12.0	6.4	14.8	1400	47.3	3.25	36.2	95.8	4.26	6.7	1700	54.2	38.5	0.71	2.50	62.7	21.7	2.9
70	6.0	1.6	3.6	1400	44.9	3.27	33.7	99.7	4.02	7.4	1400	50.5	32.6	0.64	3.10	61.1	16.3	3.7
	9.0	3.5	8.1	1700	46.5	3.25	35.4	95.3	4.19	6.9	1700	52.1	38.4	0.74	3.24	63.1	16.1	3.8
	12.0	6.4	14.8	1400	48.5	3.35	37.1	102.1	4.25	7.9	1400	51.4	32.8	0.64	2.75	60.7	18.7	3.4
80	6.0	1.4	3.3	1400	50.4	3.31	39.1	97.5	4.47	7.3	1700	52.9	38.6	0.73	2.88	62.8	18.4	3.6
	9.0	3.3	7.6	1700	50.4	3.31	39.1	103.5	4.39	8.3	1400	51.9	32.9	0.63	2.61	60.8	19.9	3.2
	12.0	6.0	13.8	1400	52.4	3.34	41.0	98.5	4.60	7.6	1700	53.5	38.7	0.72	2.73	62.8	19.6	3.5
70	6.0	1.5	3.5	1400	48.8	3.41	37.2	102.3	4.20	8.4	1400	49.9	32.6	0.65	3.28	61.1	15.2	4.6
	9.0	3.4	7.9	1700	50.7	3.37	39.2	97.6	4.41	7.8	1700	51.4	38.3	0.75	3.44	63.2	15.0	4.8
	12.0	6.2	14.3	1400	53.0	3.47	41.1	105.0	4.48	8.9	1400	50.4	32.9	0.65	2.97	60.5	16.9	4.2
80	6.0	1.4	3.3	1400	53.0	3.47	41.1	105.0	4.48	8.9	1700	52.0	38.7	0.74	3.11	62.6	16.7	4.5
	9.0	3.3	7.6	1700	55.1	3.41	43.4	100.0	4.73	8.3	1400	51.3	33.1	0.65	2.84	61.0	18.0	3.9
	12.0	6.0	13.8	1400	55.4	3.51	43.4	106.6	4.63	9.4	1700	52.8	38.9	0.74	2.95	62.9	17.9	4.3
90	6.0	1.4	3.3	1400	52.7	3.56	40.5	104.8	4.33	9.6	1400	47.9	32.0	0.67	3.50	59.8	13.7	5.8
	9.0	3.2	7.3	1700	54.7	3.50	42.8	99.8	4.58	8.9	1700	49.4	37.6	0.76	3.65	61.9	13.5	6.1
	12.0	5.8	13.3	1400	57.2	3.60	44.9	107.8	4.65	10.2	1400	48.2	32.4	0.67	3.25	59.3	14.8	5.3
100	6.0	1.4	3.2	1400	60.1	3.64	47.7	109.8	4.84	10.7	1400	49.2	32.6	0.66	3.11	59.9	15.8	5.0
	9.0	3.2	7.3	1700	62.5	3.54	50.4	104.1	5.17	9.9	1700	50.8	38.3	0.76	3.24	61.8	15.7	5.5
	12.0	5.6	12.9	1400	56.5	3.72	43.9	107.4	4.46	10.9	1400	45.9	31.4	0.68	3.72	58.6	12.3	7.4
110	6.0	1.3	3.1	Operation not recommended							1400	43.0	31.3	0.73	3.88	56.2	11.1	8.2
	9.0	3.1	7.1								1700	44.3	36.9	0.83	4.03	58.1	11.0	8.8
	12.0	5.6	12.9								1400	44.6	31.8	0.71	3.74	57.4	11.9	7.8
120	6.0	1.3	3.0	Operation not recommended							1700	45.9	37.3	0.81	3.90	59.2	11.8	8.6
	9.0	2.9	6.8								1400	40.1	30.8	0.77	4.22	54.5	9.5	10.3
	12.0	5.4	12.4								1700	41.4	36.3	0.88	4.40	56.4	9.4	11.3
120	6.0	1.2	2.9	Operation not recommended							1400	42.0	31.4	0.75	4.09	56.0	10.3	9.9
	9.0	2.8	6.5								1700	43.2	36.8	0.85	4.27	57.7	10.1	11.0
	12.0	5.1	11.9								1400	38.9	31.9	0.82	4.74	55.1	8.2	13.1
Performance capacities shown in thousands of Mbtu/h.																		

Performance Data cont.

048 - Part Load Dual Capacity with 5-Speed ECM (1250 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	5.0	1.2	2.7	Operation not recommended							Operation not recommended							
	8.0	3.2	7.3															
	11.0	6.1	14.1	1000	22.6	2.20	15.1	91.0	3.01	4.4	1250	23.5	2.24	15.8	87.4	3.08	4.0	
30	5.0	1.1	2.6	Operation not recommended							Operation not recommended							
	8.0	3.1	7.1	1000	25.6	2.20	18.1	93.7	3.41	4.4	1250	26.4	2.22	18.9	89.6	3.49	4.0	
	11.0	5.9	13.7	1000	26.3	2.22	18.7	94.3	3.47	4.5	1250	27.2	2.25	19.5	90.2	3.55	4.1	
40	5.0	1.1	2.5	Operation not recommended							Operation not recommended							
	8.0	3.0	6.9	1000	29.0	2.23	21.4	96.8	3.80	4.6	1250	30.0	2.23	22.4	92.2	3.94	4.2	
	11.0	5.7	13.2	1000	29.9	2.25	22.3	97.7	3.90	4.7	1250	31.0	2.26	23.2	92.9	4.01	4.3	
50	5.0	1.1	2.5	1000	30.0	2.19	22.5	97.8	4.01	4.8	1250	31.0	2.19	23.5	92.9	4.14	4.5	
	8.0	2.9	6.7	1000	32.3	2.26	24.6	100.0	4.19	5.0	1250	33.6	2.25	25.9	94.9	4.37	4.6	
	11.0	5.6	12.8	1000	33.6	2.28	25.8	101.1	4.32	5.1	1250	34.7	2.28	26.9	95.7	4.46	4.7	
60	5.0	1.0	2.4	1000	32.7	2.23	25.0	100.2	4.29	5.3	1250	33.8	2.22	26.3	95.1	4.47	4.9	
	8.0	2.8	6.5	1000	35.3	2.29	27.5	102.7	4.53	5.4	1250	36.7	2.26	29.0	97.2	4.76	5.0	
	11.0	5.4	12.4	1000	36.8	2.31	29.0	104.1	4.68	5.6	1250	38.2	2.28	30.4	98.3	4.90	5.1	
70	5.0	1.0	2.3	1000	35.3	2.27	27.6	102.7	4.57	5.8	1250	36.7	2.24	29.1	97.2	4.80	5.4	
	8.0	2.7	6.2	1000	38.4	2.31	30.5	105.5	4.87	6.0	1250	39.9	2.27	32.1	99.5	5.15	5.6	
	11.0	5.2	12.0	1000	40.1	2.33	32.1	107.1	5.04	6.2	1250	41.6	2.28	33.8	100.8	5.35	5.7	
80	5.0	1.0	2.2	1000	38.1	2.31	30.2	105.3	4.84	6.6	1250	39.6	2.27	31.9	99.3	5.12	6.1	
	8.0	2.6	6.0	1000	41.4	2.33	33.4	108.3	5.20	6.8	1250	43.1	2.27	35.3	101.9	5.55	6.3	
	11.0	5.0	11.6	1000	43.5	2.36	35.4	110.3	5.40	7.0	1250	45.2	2.29	37.4	103.5	5.78	6.5	
90	5.0	0.9	2.2	1000	40.9	2.35	32.9	107.8	5.11	7.5	1250	42.5	2.30	34.6	101.5	5.42	7.0	
	8.0	2.5	5.8	1000	44.4	2.36	36.4	111.1	5.52	7.8	1250	46.3	2.28	38.5	104.3	5.94	7.2	
	11.0	4.8	11.2	1000	46.9	2.38	38.8	113.4	5.76	8.0	1250	48.9	2.31	41.0	106.2	6.20	7.4	
100	5.0	0.9	2.1	Operation not recommended							Operation not recommended							
	8.0	2.4	5.6								1000	31.3	23.3	0.74	2.64	40.3	11.8	6.4
	11.0	4.7	10.8								1250	32.2	27.4	0.85	2.74	41.6	11.8	7.0
110	5.0	0.9	2.0	Operation not recommended							1000	32.4	23.6	0.73	2.54	41.1	12.8	6.0
	8.0	2.3	5.4								1250	33.4	27.7	0.83	2.65	42.4	12.6	6.6
	11.0	4.5	10.4								Operation not recommended							
120	5.0	0.8	1.9	Operation not recommended							1000	28.2	24.0	0.85	3.40	39.7	8.3	11.0
	8.0	2.2	5.2								1250	28.7	26.1	0.91	3.49	40.6	8.2	11.7
	11.0	4.3	10.0								1000	28.4	24.0	0.85	3.29	39.6	8.6	9.7
Performance capacities shown in thousands of Mbtu/h.																		

7/18/14

Performance Data cont.

060 - Full Load Dual Capacity with 5-Speed ECM (1800 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F						COOLING - EAT 80/67 °F										
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h		
20	8.0	2.9	6.8	Operation not recommended									Operation not recommended							
	12.0	6.0	13.8																	
	16.0	10.1	23.3	1500	38.6	3.93	25.2	93.8	2.88	6.1										
30	8.0	2.8	6.6	Operation not recommended									Operation not recommended							
	12.0	5.8	13.4	1500	43.9	3.97	30.3	97.1	3.24	6.4	1500	52.9	32.2	0.61	2.69	62.1	19.6	-		
	16.0	9.8	22.6	1800	45.1	4.23	30.7	93.2	3.13	5.8	1800	53.7	35.2	0.65	2.84	63.4	18.9	-		
40	8.0	2.8	6.4	Operation not recommended									Operation not recommended							
	12.0	5.6	13.0	1500	50.3	4.17	36.1	101.1	3.53	7.0	1500	56.9	35.4	0.62	2.95	67.0	19.3	-		
	16.0	9.5	21.9	1800	51.5	4.35	36.6	96.5	3.47	6.4	1800	58.0	38.6	0.67	3.09	68.5	18.8	-		
50	8.0	2.7	6.2	1500	53.6	4.28	39.0	103.1	3.67	7.5	1500	60.4	38.0	0.63	3.16	71.2	19.1	3.6		
	12.0	5.4	12.6	1800	54.8	4.42	39.7	98.2	3.63	7.0	1800	61.6	41.3	0.67	3.37	73.1	18.3	3.8		
	16.0	9.2	21.2	1500	56.7	4.37	41.8	105.0	3.81	7.8	1500	61.0	38.3	0.63	3.10	71.6	19.7	3.3		
60	8.0	2.6	6.0	1500	60.1	4.51	44.7	107.1	3.91	8.5	1500	59.7	38.5	0.65	3.44	71.4	17.4	4.4		
	12.0	5.3	12.2	1800	61.4	4.58	45.8	101.6	3.93	7.8	1800	61.2	41.9	0.68	3.66	73.7	16.7	4.6		
	16.0	8.9	20.6	1500	62.9	4.58	47.2	108.8	4.02	8.7	1500	60.3	38.9	0.64	3.37	71.8	17.9	4.1		
70	8.0	2.5	5.8	1500	66.6	4.72	50.4	111.1	4.13	9.5	1500	59.0	39.1	0.66	3.71	71.6	15.9	5.4		
	12.0	5.1	11.8	1800	68.0	4.74	51.8	105.0	4.20	8.8	1800	60.8	42.5	0.70	3.95	74.3	15.4	5.7		
	16.0	8.6	19.9	1500	69.0	4.79	52.6	112.6	4.22	9.8	1500	59.5	39.5	0.66	3.64	72.0	16.4	5.0		
80	8.0	2.4	5.6	1500	72.9	4.97	55.9	115.0	4.30	10.6	1500	56.9	38.8	0.68	4.03	70.6	14.1	7.0		
	12.0	4.9	11.4	1800	74.6	4.94	57.7	108.4	4.42	9.8	1800	59.0	42.1	0.71	4.29	73.6	13.7	7.4		
	16.0	8.3	19.2	1500	74.6	5.03	57.5	116.1	4.35	11.0	1500	57.5	39.1	0.68	3.95	70.9	14.5	6.5		
90	8.0	2.3	5.4	1500	76.9	5.09	59.4	109.3	4.50	10.1	1800	59.6	42.5	0.71	4.20	73.9	14.2	7.0		
	12.0	4.8	11.0	1800	76.4	4.98	59.4	113.7	4.28	10.1	1500	60.1	39.8	0.66	3.58	72.3	16.8	4.7		
	16.0	8.0	18.5	1500	76.9	5.09	59.5	117.5	4.43	11.3	1500	58.0	39.5	0.68	3.88	71.3	14.9	6.0		
100	8.0	2.2	5.2	Operation not recommended									Operation not recommended							
	12.0	4.6	10.6								1500	51.7	37.3	0.72	4.70	67.8	11.0	10.2		
	16.0	7.7	17.8								1800	54.2	40.5	0.75	5.00	71.3	10.8	11.0		
110	8.0	2.2	5.0	Operation not recommended									1500	52.2	37.7	0.72	4.61	68.0	11.3	9.5
	12.0	4.4	10.2								1800	54.7	40.9	0.75	4.92	71.5	11.1	10.5		
	16.0	7.4	17.2								1500	48.1	35.8	0.74	5.13	65.6	9.4	13.1		
120	8.0	2.1	4.8	Operation not recommended									1800	50.7	38.9	0.77	5.47	69.4	9.3	14.2
	12.0	4.2	9.8								1500	48.6	36.2	0.75	5.04	65.8	9.6	12.2		
	16.0	7.1	16.5								1800	51.2	39.3	0.77	5.38	69.5	9.5	13.5		

Performance capacities shown in thousands of Mbtu/h.

7/18/14

Performance Data cont.

060 - Part Load Dual Capacity with 5-Speed ECM (1500 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	6.0	1.8	4.1	Operation not recommended							Operation not recommended							
	10.0	4.3	10.0															
	14.0	7.8	18.1	1250	27.7	3.01	17.5	90.5	2.70	5.3	1500	28.7	3.05	18.3	87.7	2.76	4.8	
30	6.0	1.7	3.9	Operation not recommended							Operation not recommended							
	10.0	4.2	9.7	1250	30.9	3.05	20.5	92.9	2.97	5.1	1500	39.9	23.5	0.59	1.57	45.2	25.4	-
	14.0	7.6	17.6	1250	32.0	3.09	21.5	89.8	3.04	4.7	1500	40.5	25.7	0.63	1.65	46.2	24.5	-
40	6.0	1.7	3.8	Operation not recommended							Operation not recommended							
	10.0	4.1	9.4	1250	36.2	3.11	25.6	96.8	3.41	5.4	1500	44.0	27.8	0.63	1.73	49.9	25.5	-
	14.0	7.4	17.1	1250	37.2	3.12	26.6	93.0	3.49	5.0	1500	44.8	30.3	0.68	1.81	51.0	24.8	-
50	6.0	1.6	3.7	1250	40.8	3.12	30.2	100.2	3.84	5.7	1500	48.0	30.5	0.64	1.92	54.5	25.0	1.9
	10.0	4.0	9.1	1250	41.9	3.12	31.3	95.9	3.94	5.3	1500	49.4	34.7	0.70	2.03	56.3	24.4	2.0
	14.0	7.2	16.5	1250	41.5	3.18	30.6	100.7	3.83	5.9	1250	48.1	30.8	0.64	1.85	54.4	26.0	1.7
60	6.0	1.6	3.6	1250	42.4	3.16	31.6	96.2	3.94	5.4	1500	49.5	34.9	0.71	1.94	56.1	25.5	1.9
	10.0	3.8	8.8	1250	42.7	3.20	31.8	101.6	3.92	6.0	1250	48.2	30.8	0.64	1.82	54.4	26.6	1.6
	14.0	6.9	16.0	1250	43.7	3.18	32.8	97.0	4.03	5.5	1500	49.6	34.9	0.70	1.90	56.1	26.1	1.8
70	6.0	1.5	3.5	1250	45.2	3.18	34.3	103.5	4.16	6.2	1250	46.4	30.4	0.66	2.16	53.8	21.5	2.6
	10.0	3.7	8.6	1250	46.2	3.16	35.4	98.5	4.29	5.7	1500	47.8	34.4	0.72	2.26	55.6	21.2	2.8
	14.0	6.7	15.5	1250	46.6	3.24	35.6	104.5	4.22	6.4	1250	46.6	30.7	0.66	2.09	53.8	22.3	2.5
80	6.0	1.4	3.3	1250	47.3	3.19	36.5	99.2	4.35	5.9	1500	48.0	34.7	0.72	2.18	55.5	22.0	2.7
	10.0	3.6	8.3	1250	47.7	3.27	36.6	105.3	4.28	6.6	1250	46.8	30.8	0.66	2.05	53.8	22.9	2.3
	14.0	6.5	15.0	1250	48.5	3.22	37.5	99.9	4.41	6.1	1500	48.2	34.8	0.72	2.14	55.5	22.5	2.5
70	6.0	1.5	3.5	1250	49.6	3.25	38.5	106.7	4.48	6.9	1250	44.9	30.4	0.68	2.40	53.1	18.7	3.7
	10.0	3.7	8.6	1250	50.4	3.19	39.5	101.1	4.63	6.4	1500	46.3	34.0	0.74	2.50	54.8	18.5	3.9
	14.0	6.7	15.5	1250	51.7	3.30	40.4	108.3	4.59	7.1	1250	45.2	30.6	0.68	2.33	53.1	19.4	3.4
80	6.0	1.4	3.3	1250	52.3	3.23	41.2	102.3	4.74	6.5	1500	46.6	34.4	0.74	2.43	54.8	19.2	3.7
	10.0	3.6	8.3	1250	52.7	3.34	41.3	109.0	4.63	7.3	1250	45.4	30.8	0.68	2.28	53.2	19.9	3.2
	14.0	6.5	15.0	1250	53.2	3.27	42.1	102.9	4.78	6.7	1500	46.8	34.6	0.74	2.38	55.0	19.7	3.5
90	6.0	1.4	3.2	1250	53.8	3.29	42.6	109.8	4.79	7.7	1250	42.8	30.0	0.70	2.72	52.0	15.7	5.0
	10.0	3.4	8.0	1250	54.3	3.22	43.3	103.5	4.94	7.1	1500	44.1	33.5	0.76	2.81	53.7	15.7	5.3
	14.0	6.5	15.0	1250	56.8	3.34	45.4	112.1	4.98	7.9	1250	43.1	30.3	0.70	2.65	52.2	16.3	4.7
90	6.0	1.4	3.2	1250	57.1	3.25	46.0	105.2	5.16	7.3	1500	44.4	34.0	0.76	2.75	53.8	16.1	5.1
	10.0	3.4	8.0	1250	57.5	3.39	45.9	112.6	4.97	8.1	1250	43.4	30.5	0.70	2.61	52.3	16.6	4.4
	14.0	6.2	14.4	1250	57.7	3.29	46.5	105.6	5.14	7.5	1500	44.8	34.2	0.76	2.70	54.0	16.6	4.8
100	6.0	1.3	3.1	Operation not recommended							Operation not recommended							
	10.0	3.3	7.7								1250	37.9	29.2	0.77	3.39	49.4	11.2	8.0
	14.0	6.0	13.9								1500	39.0	32.3	0.83	3.48	50.9	11.2	8.7
110	6.0	1.3	3.0								1250	38.3	29.6	0.77	3.35	49.7	11.4	7.5
	10.0	3.2	7.4								1250	36.2	31.7	0.87	3.83	49.3	9.5	10.7
	14.0	5.8	13.4								Operation not recommended							
120	6.0	1.2	2.9	Operation not recommended							Operation not recommended							
	10.0	3.1	7.1								1250	34.2	28.0	0.82	4.31	48.9	7.9	13.6
	14.0	5.6	12.9								1500	34.8	30.4	0.87	4.43	49.9	7.9	14.5
	1250	34.5	28.0	0.81	4.17	48.7	8.3	1250	35.2	30.4	0.86	4.31	49.9	8.2	12.5	13.8		

Performance capacities shown in thousands of Mbtu/h.

7/18/14

Performance Data cont.

072 - Full Load Dual Capacity with 5-Speed ECM High Speed (2300 cfm)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow cfm	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	12.0	4.0	9.1	Operation not recommended							Operation not recommended							
	15.0	5.9	13.5	1850	49.3	4.60	33.6	94.7	3.14	8.7	1850	57.3	35.2	0.61	3.14	68.0	18.2	-
	18.0	8.1	18.7	2300	51.1	4.90	34.4	90.6	3.06	7.9	2300	58.2	38.5	0.66	3.31	69.5	17.6	-
30	12.0	3.8	8.9	Operation not recommended							Operation not recommended							
	15.0	5.7	13.1	1850	55.5	4.74	39.3	97.8	3.43	9.0	1850	63.0	39.9	0.63	3.47	74.8	18.2	-
	18.0	7.8	18.1	2300	57.5	5.04	40.2	93.1	3.34	8.2	2300	64.2	43.6	0.68	3.64	76.6	17.7	-
40	12.0	3.7	8.6	Operation not recommended							Operation not recommended							
	15.0	5.5	12.7	1850	63.0	4.97	46.0	101.5	3.71	9.7	1850	63.0	39.9	0.63	3.47	74.8	18.2	-
	18.0	7.6	17.6	2300	65.1	5.21	47.4	96.2	3.67	8.9	2300	64.2	43.6	0.68	3.64	76.6	17.7	-
50	12.0	3.6	8.3	1850	66.8	5.10	49.3	103.4	3.83	10.4	1850	68.1	43.8	0.64	3.74	80.8	18.2	4.0
	15.0	5.3	12.3	2300	69.0	5.28	51.0	97.8	3.83	9.6	2300	69.5	47.6	0.69	3.98	83.1	17.5	4.3
	18.0	7.4	17.0	1850	70.5	5.20	52.8	105.3	3.97	10.7	1850	68.8	44.3	0.64	3.66	81.3	18.8	3.8
60	12.0	3.5	8.1	2300	72.8	5.37	54.5	99.3	3.98	9.9	2300	70.1	48.2	0.69	3.90	83.4	18.0	4.1
	15.0	5.2	11.9	1850	71.8	5.26	53.8	105.9	4.00	11.1	1850	69.5	45.2	0.65	3.60	81.8	19.3	3.5
	18.0	7.1	16.5	2300	74.1	5.42	55.6	99.8	4.01	10.1	2300	70.9	48.6	0.69	3.84	83.9	18.5	3.9
70	12.0	3.4	7.8	1850	74.9	5.40	56.5	107.5	4.07	11.7	1850	69.2	46.3	0.67	4.08	83.1	16.9	5.1
	15.0	5.0	11.6	2300	77.3	5.50	58.5	101.1	4.12	10.8	2300	70.6	50.1	0.71	4.34	85.4	16.3	5.4
	18.0	6.9	15.9	1850	78.2	5.49	59.4	109.1	4.17	12.0	1850	69.9	46.8	0.67	4.00	83.5	17.5	4.7
80	12.0	3.3	7.5	2300	80.7	5.58	61.7	102.5	4.24	11.1	2300	71.3	50.6	0.71	4.25	85.8	16.8	5.1
	15.0	4.8	11.2	1850	79.9	5.56	61.0	110.0	4.22	12.4	1850	70.6	47.5	0.67	3.93	84.0	18.0	4.4
	18.0	6.7	15.4	2300	82.6	5.63	63.3	103.2	4.29	11.4	2300	72.0	51.1	0.71	4.19	86.3	17.2	4.9
70	12.0	3.4	7.8	1850	85.6	5.72	66.0	104.4	4.38	12.1	1850	70.3	48.8	0.69	4.43	85.4	15.9	6.5
	15.0	5.0	11.6	2300	85.9	5.77	66.2	113.0	4.36	13.5	1850	71.0	49.3	0.69	4.34	85.8	16.4	6.0
	18.0	6.9	15.9	1850	88.6	5.78	68.8	105.7	4.49	12.4	1850	72.4	53.0	0.73	4.60	88.1	15.7	6.5
80	12.0	3.3	7.5	1850	88.1	5.85	68.1	114.1	4.42	13.9	1850	71.7	49.8	0.69	4.26	86.3	16.9	5.6
	15.0	4.8	11.2	2300	91.0	5.85	71.0	106.6	4.56	12.8	2300	73.2	53.6	0.73	4.54	88.7	16.1	6.2
	18.0	6.7	15.4	1850	95.8	6.19	74.7	118.0	4.54	15.7	1850	68.5	48.9	0.71	4.67	84.5	14.7	7.1
90	12.0	3.1	7.3	1850	98.7	6.37	77.0	119.4	4.54	16.7	1850	64.0	46.6	0.73	5.28	82.0	12.1	10.5
	15.0	4.7	10.8	2300	102.0	6.24	80.7	111.1	4.79	15.4	2300	65.4	50.6	0.77	5.62	84.5	11.6	11.1
	18.0	6.4	14.9	1850	100.1	6.44	78.1	120.1	4.55	17.2	1850	64.6	47.0	0.73	5.17	82.3	12.5	9.8
100	12.0	3.0	7.0	2300	103.4	6.27	81.9	111.6	4.83	15.9	2300	66.0	51.0	0.77	5.51	84.8	12.0	10.6
	15.0	4.5	10.4	1850	103.5	6.53	81.3	121.8	4.65	17.7	1850	65.4	48.0	0.73	5.08	82.7	12.9	9.1
	18.0	6.2	14.3	2300	107.0	6.34	85.3	113.1	4.94	16.4	2300	66.7	51.6	0.77	5.41	85.2	12.3	10.1
110	12.0	2.9	6.7	Operation not recommended							Operation not recommended							
	15.0	4.3	10.0	1850	58.0	43.8	0.75	6.29	79.5	9.2	1850	59.2	47.1	0.79	6.69	82.1	8.9	16.9
	18.0	6.0	13.8	1850	58.7	44.2	0.75	6.18	79.8	9.5	1850	59.9	47.5	0.79	6.57	82.3	9.1	16.0
120	12.0	2.8	6.5	Operation not recommended							Operation not recommended							
	15.0	4.2	9.6	1850	54.0	42.2	0.78	7.25	78.7	7.4	1850	55.0	45.8	0.83	7.44	80.3	7.4	20.0
	18.0	5.7	13.2	1850	54.5	42.2	0.78	7.01	78.4	7.8	1850	55.6	45.8	0.82	7.24	80.3	7.7	19.0

Performance capacities shown in thousands of Btu/h.

7/18/14

Performance Data cont.

072 - Part Load Dual Capacity with 5-Speed ECM (1850 cfm)


EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	Airflow cfm	HC Mbtu/h	Power kW	HE Mbtu/h	LAT °F	COP	HWC Mbtu/h	Airflow cfm	TC Mbtu/h	SC Mbtu/h	S/T Ratio	Power kW	HR Mbtu/h	EER	HWC Mbtu/h
20	10.0	2.9	6.8	Operation not recommended										Operation not recommended				
	13.0	4.6	10.5															
	16.0	6.6	15.1	1650	36.0	3.74	23.3	90.2	2.82	7.0	1850	37.8	3.79	24.8	88.9	2.92	6.3	
30	10.0	2.8	6.6	Operation not recommended										Operation not recommended				
	13.0	4.4	10.2	1650	39.7	3.81	26.7	92.3	3.05	6.9	1850	47.9	29.6	0.62	1.96	54.6	24.5	-
	16.0	6.4	14.7	1850	41.6	3.86	28.5	90.8	3.16	6.4	1850	48.7	32.4	0.66	2.06	55.8	23.6	-
	10.0	2.8	6.6	1650	41.4	3.81	28.4	93.2	3.19	7.1	1850	48.2	29.6	0.61	1.90	54.7	25.3	-
40	10.0	2.8	6.4	Operation not recommended										Operation not recommended				
	13.0	4.3	9.9	1650	46.1	3.92	32.8	95.9	3.45	7.3	1850	52.8	34.3	0.65	2.17	60.2	24.3	-
	16.0	6.2	14.3	1850	48.2	3.93	34.8	94.1	3.59	6.7	1850	53.8	37.4	0.70	2.28	61.5	23.6	-
	10.0	2.7	6.2	1650	47.8	3.93	34.4	96.8	3.56	7.5	1650	53.2	34.3	0.64	2.11	60.4	25.2	-
50	10.0	2.7	6.2	Operation not recommended										Operation not recommended				
	13.0	4.2	9.6	1650	52.5	4.02	38.8	99.5	3.83	7.9	1650	57.5	37.4	0.65	2.35	65.5	24.4	2.1
	16.0	6.0	13.8	1850	54.7	4.00	41.0	97.4	4.00	7.3	1850	59.3	42.5	0.72	2.48	67.7	23.9	2.3
	10.0	2.6	6.0	1650	54.1	3.94	40.7	97.1	4.03	7.1	1850	59.1	42.1	0.71	2.56	67.9	23.1	2.4
60	10.0	2.6	6.0	Operation not recommended										Operation not recommended				
	13.0	4.0	9.3	1650	59.3	4.15	45.2	103.3	4.19	8.7	1650	56.6	38.0	0.67	2.66	65.7	21.3	3.0
	16.0	5.8	13.4	1850	61.7	4.07	47.8	100.9	4.44	8.0	1850	58.3	43.0	0.74	2.79	67.8	20.9	3.3
	10.0	2.5	5.8	1650	60.7	4.19	46.4	104.1	4.24	9.0	1650	56.9	38.1	0.67	2.61	65.8	21.8	2.8
70	10.0	2.5	5.8	Operation not recommended										Operation not recommended				
	13.0	3.9	9.0	1650	66.1	4.27	51.5	107.1	4.53	9.7	1650	55.8	38.6	0.69	2.97	65.9	18.8	4.2
	16.0	5.6	12.9	1850	68.7	4.15	54.5	104.4	4.85	8.9	1850	57.4	43.5	0.76	3.09	67.9	18.6	4.6
	10.0	2.4	5.6	1650	67.3	4.34	52.5	107.8	4.55	10.0	1650	56.1	38.8	0.69	2.93	66.1	19.1	3.9
80	10.0	2.4	5.6	Operation not recommended										Operation not recommended				
	13.0	3.8	8.7	1650	73.0	4.37	58.1	111.0	4.89	10.9	1650	47.5	37.5	0.79	3.40	59.1	14.0	5.2
	16.0	5.4	12.5	1850	75.6	4.20	61.3	107.8	5.28	10.1	1850	48.9	42.0	0.86	3.50	60.9	14.0	5.6
	10.0	2.3	5.4	1650	73.8	4.43	58.7	111.4	4.88	11.3	1650	47.9	37.8	0.79	3.35	59.3	14.3	4.8
90	10.0	2.3	5.4	Operation not recommended										Operation not recommended				
	13.0	3.6	8.4	1650	79.9	4.47	64.6	114.8	5.24	12.3	1650	48.6	36.5	0.75	3.83	61.7	12.7	7.6
	16.0	5.2	12.1	1850	82.5	4.25	68.1	111.3	5.70	11.4	1850	50.1	40.6	0.81	3.91	63.5	12.8	8.3
	10.0	2.2	5.2	1650	80.4	4.53	64.9	115.1	5.20	12.7	1650	49.1	36.8	0.75	3.77	62.0	13.0	7.1
100	10.0	2.2	5.2	Operation not recommended										Operation not recommended				
	13.0	3.5	8.1	1650	75.0	4.41	60.0	112.1	4.99	11.9	1650	48.1	36.1	0.75	3.91	61.5	12.3	8.2
	16.0	5.0	11.6	1850	77.5	4.23	63.1	108.8	5.38	11.0	1850	49.6	40.1	0.81	3.99	63.3	12.4	8.7
110	10.0	2.2	5.0	Operation not recommended										Operation not recommended				
	13.0	3.4	7.8	1650	74.0	4.37	58.1	111.0	4.89	10.9	1650	47.5	37.5	0.79	3.40	59.1	14.0	5.2
	16.0	4.8	11.2	1850	76.4	4.27	61.8	108.2	5.24	10.4	1850	47.9	37.8	0.79	3.44	66.0	15.8	5.8
120	10.0	2.1	4.8	Operation not recommended										Operation not recommended				
	13.0	3.2	7.5	1650	72.5	4.33	68.1	111.5	5.61	11.7	1850	50.7	40.9	0.81	3.85	63.8	13.2	7.9
	16.0	4.6	10.7	1850	74.0	4.23	63.1	108.8	5.38	11.0	1850	47.5	40.0	0.84	4.35	62.4	10.9	10.0
	10.0	2.2	5.2	1650	73.0	4.37	58.1	111.0	4.89	10.9	1650	47.5	37.5	0.79	3.40	59.1	14.0	5.2

Performance capacities shown in thousands of Mbtu/h.

7/18/14


Wiring Schematics

Premier with 5-Speed ECM


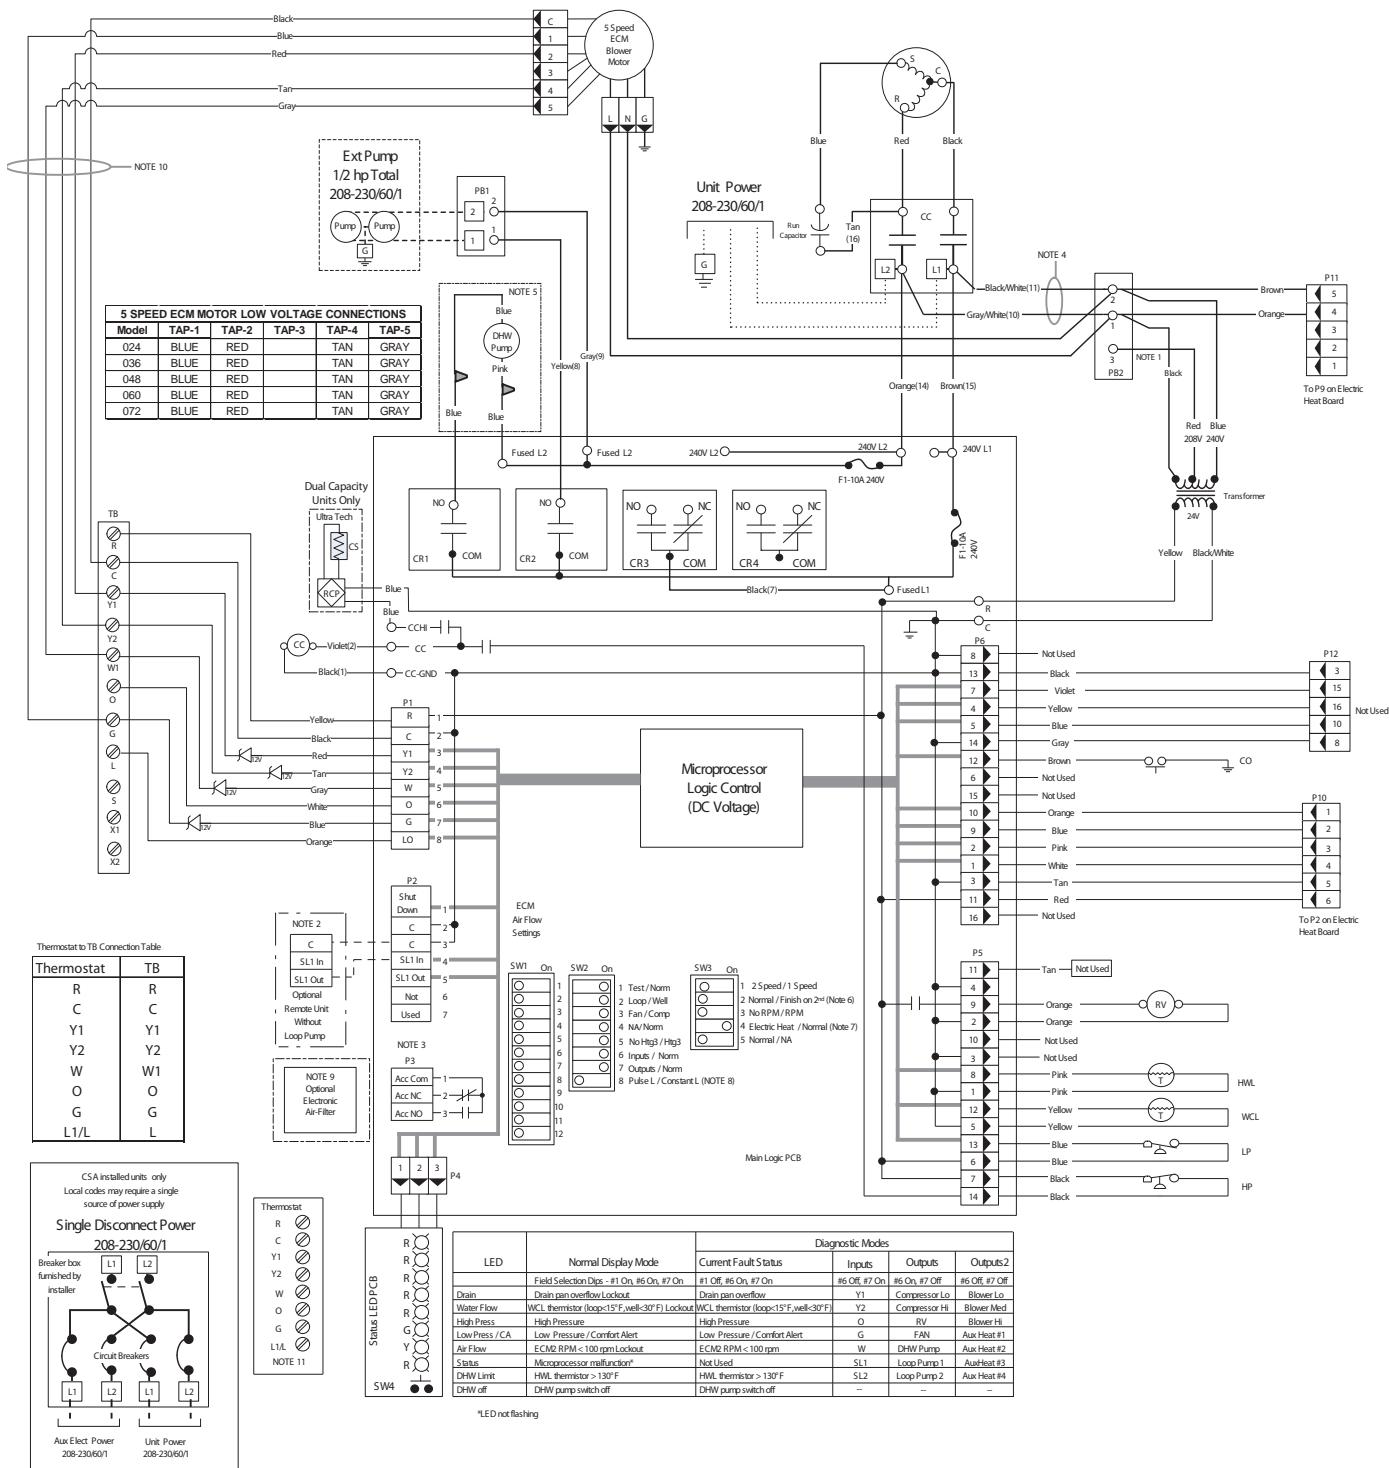


Wiring Schematics cont.

Premier with 5-Speed ECM cont.

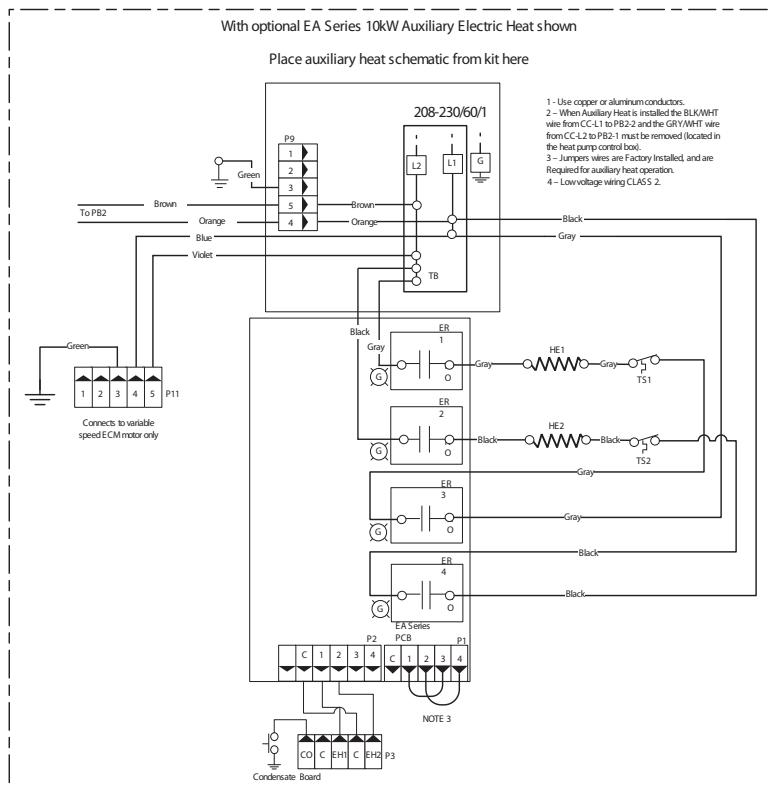


- Notes:
- 1 - Switch Blue and Red wires for 208V operation.
 - 2 - Connection of remote unit that does not have a loop pump for slave operation.
 - 3 - 24V Accessory relay (see SW2 - 3 for description of operation)
 - 4 - The blk/wht and gray/wht wires are removed when Aux Heat is installed.
 - 5 - DHW pump only in models with hot water generation option.
 - 6 - This switch allows the unit to down stage with the t-stat when OFF and finish on second stage when ON.
 - 7 - SW3-A should be in the OFF position when using the 17P501A01 electric heat board and should be ON when using the 17P514A01 electric heat board.
 - 8 - SW2-B must be in the OFF position for pulsed "L" lockout signal and in the ON position for constant "L" lockout signal.
 - 9 - When optional electronic air-filter is installed, power for the electronic air-filter is provided by P2-2 and 24 VAC.
 - 10 - Refer to 5 Speed ECM Motor Low Voltage Connection Table for factory settings.
 - 11 - Refer to Thermostat/TB Connection table for thermostat connections to unit.
 - 12 - All low voltage wiring CLASS 2
 - 13 - Use copper or aluminum conductors

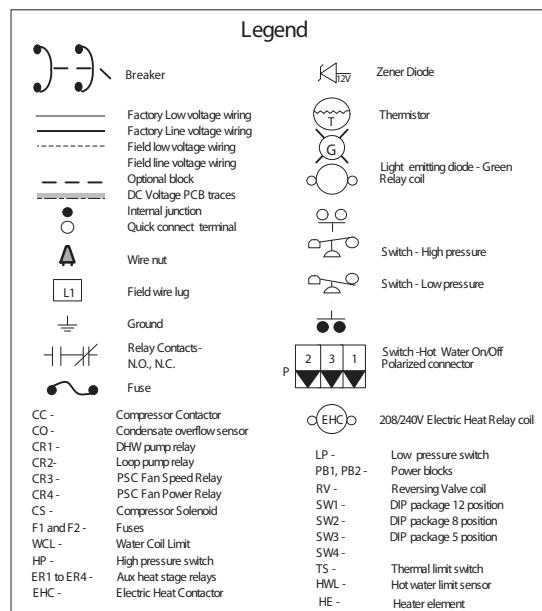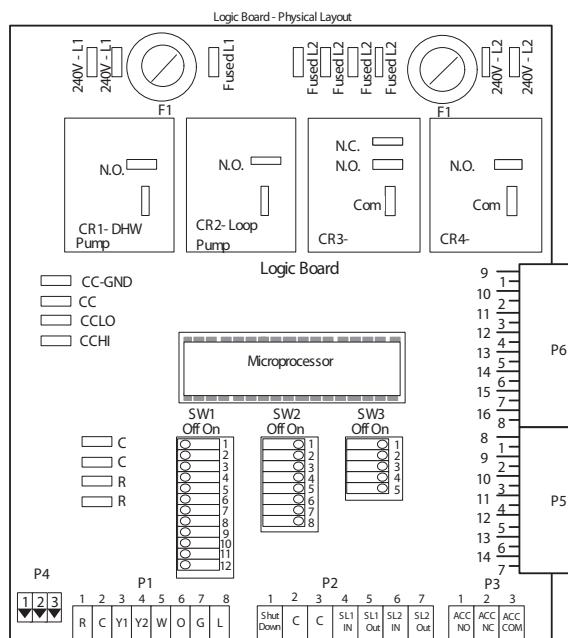



Wiring Schematics cont.

Premier with 5 Speed ECM and IntelliStart

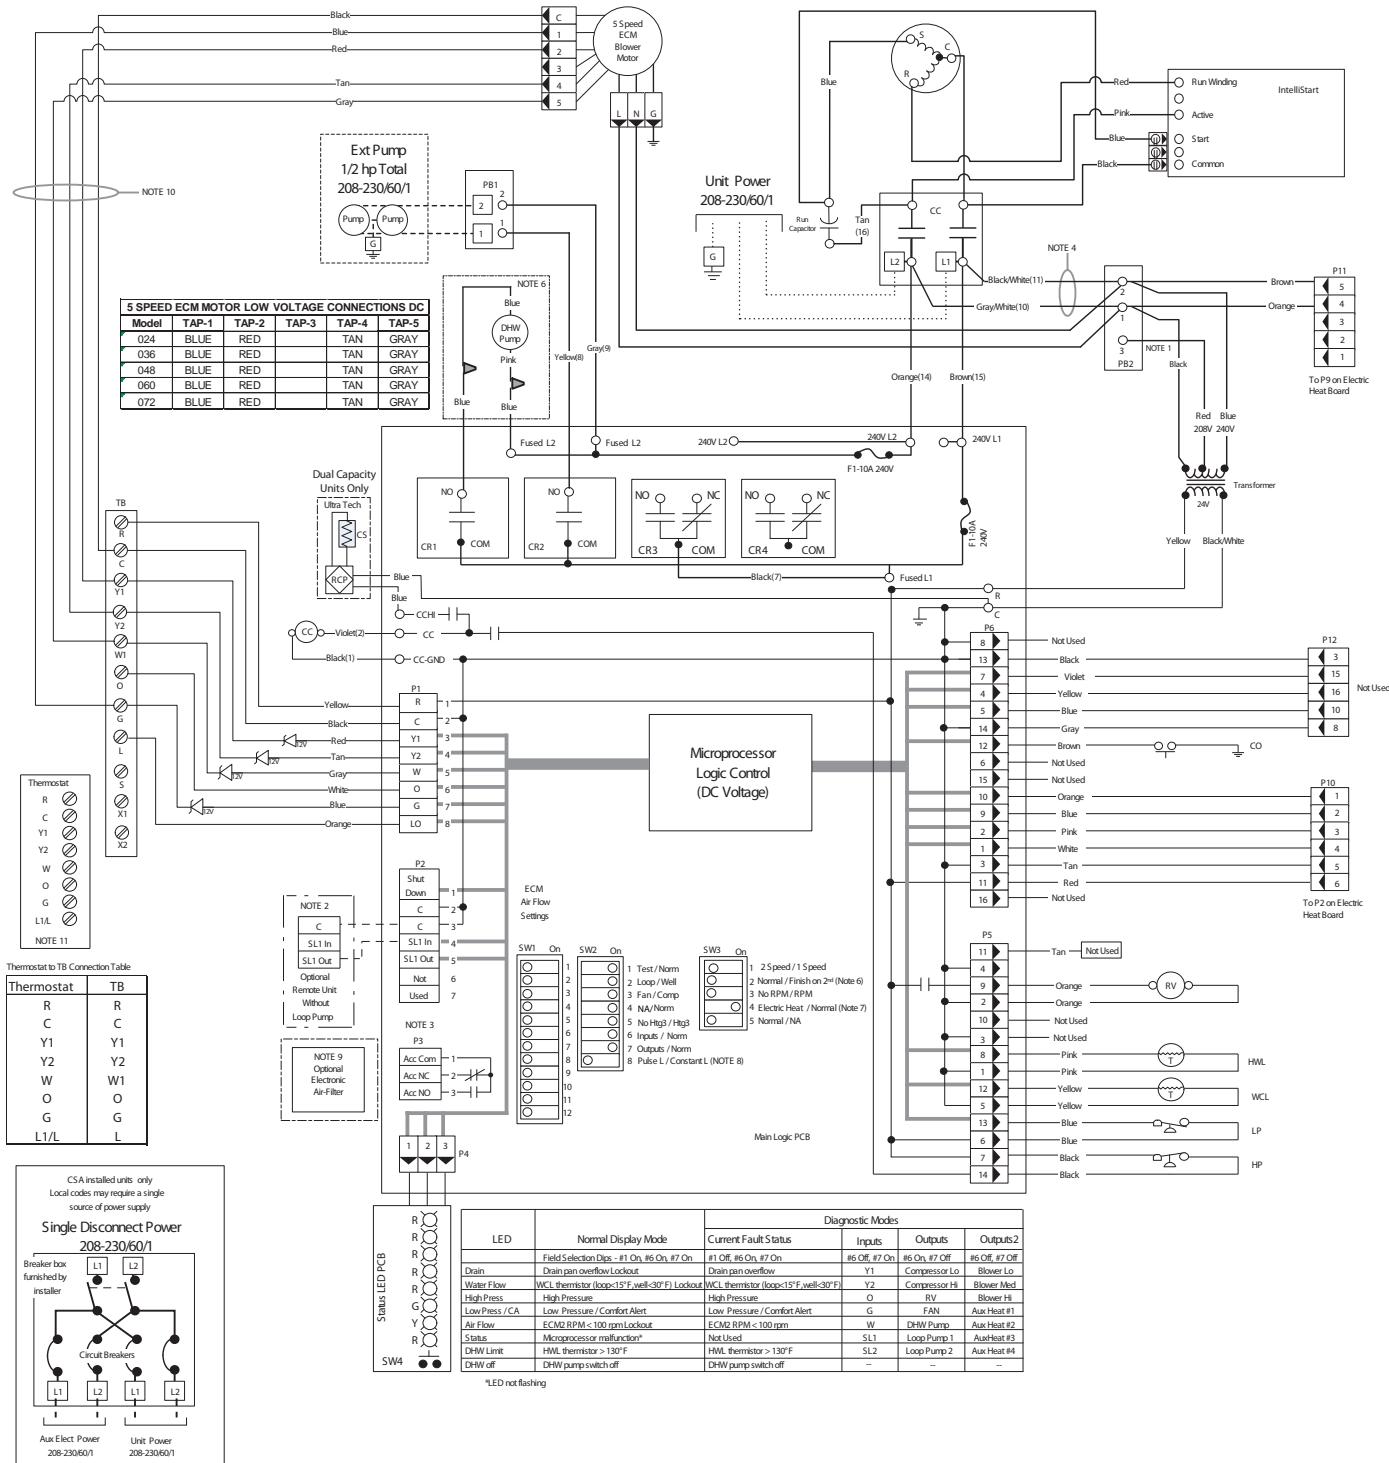

Wiring Schematics cont.

Premier with 5 Speed ECM and IntelliStart

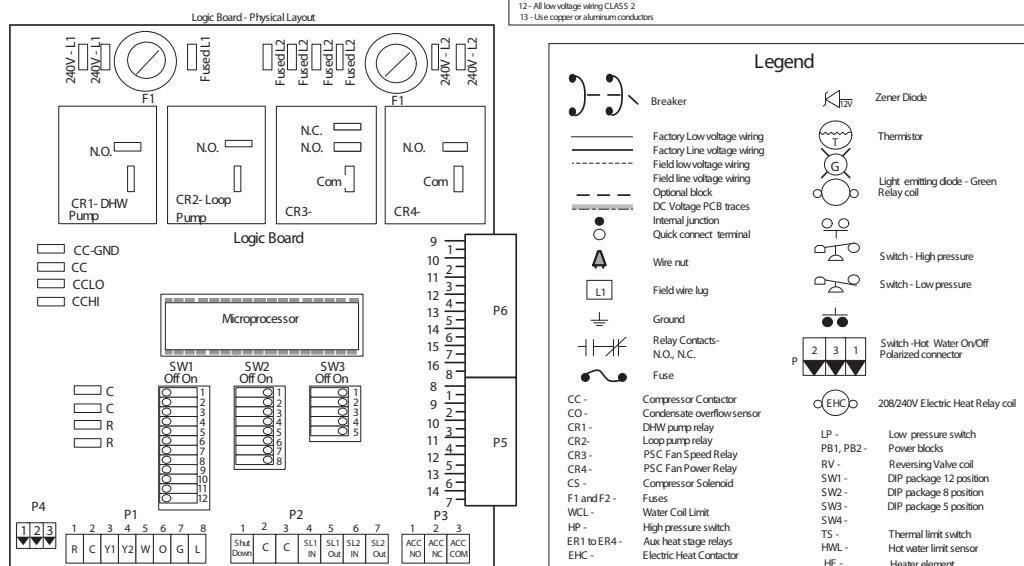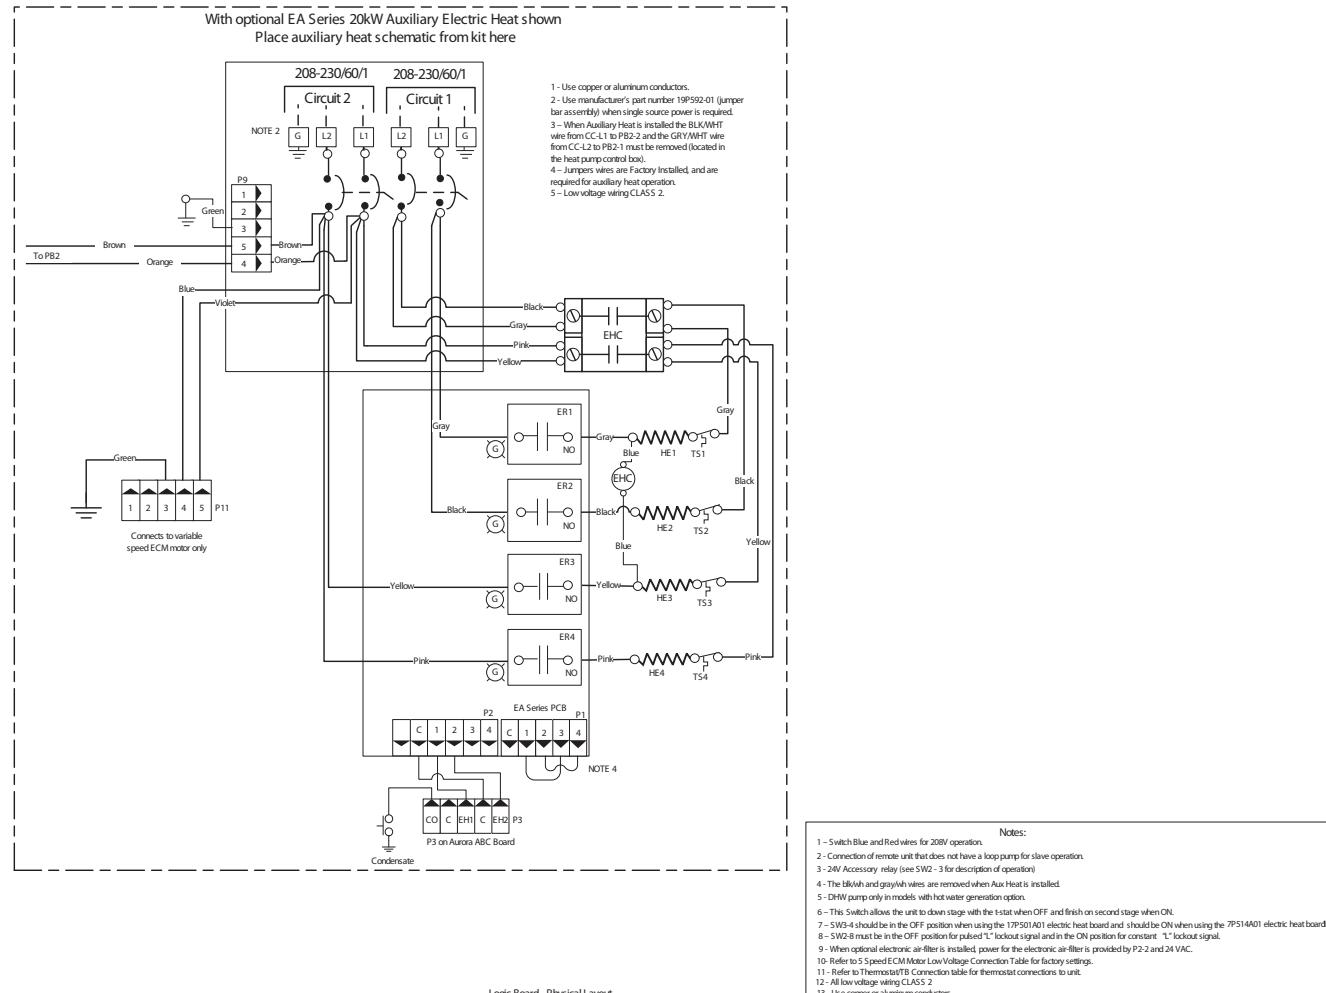

Engineering Guide Specifications

General

Furnish and install Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow. The reverse cycle heating/cooling units shall be either suspended type with horizontal air inlet and discharge or floor mounted type with horizontal air inlet and vertical upflow air discharge. Units shall be AHRI/ISO 13256-1 certified and listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory. Each unit shall be computer run-tested at the factory with conditioned water and operation verified to catalog data. Each unit shall be mounted on a pallet and shipped in a corrugated box or stretch-wrapped. The units shall be designed to operate with entering liquid temperature between 20°F and 120°F [-6.7°C and 48.9°C].

Casing and Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with corrosion-resistant powder coating. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117. The interior shall be insulated with 1/2-inch thick, multi-density, cleanable aluminum foil coated glass fiber with edges sealed or tucked under flanges to prevent the introduction of glass fibers into the discharge air. Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL-181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. Unit insulation must meet these stringent requirements or unit(s) will not be accepted.

One (horizontal) to two (vertical) blower and three compressor compartment access panels shall be 'lift-out' removable with supply and return ductwork in place. The front access panel shall be lift-out to provide easy access to the electrical/compressor section. The internal component layout shall provide for service access from the front side for restricted installations.

A duct collar shall be provided on the supply air opening. A duct flange shall be provided for the return air opening. Standard size 1 in. [2.5 cm] MERV 8 pleated filters shall be optional with filter rack. The upflow vertical units shall have a removable insulated divider panel between the air handling section and the compressor section to minimize the transmission of compressor noise and to permit operational service testing without air bypass. Vertical units shall be supplied with left or right horizontal air inlet and top air discharge. Horizontal units shall be supplied with left or right air inlet and side or end air discharge.

The compressor shall be double isolation mounted using selected durometer grommets to provide vibration free compressor mounting.

The drain pan shall be of plastic construction to inhibit corrosion and bacterial growth. Drain outlet shall be located on pan as to allow complete and unobstructed drainage of condensate. The unit as standard will be supplied with solid-state electronic condensate overflow protection. Mechanical float switches WILL NOT be accepted. Vertical units shall be furnished with a PVC slip condensate drain connection and an internal factory installed condensate trap.

Refrigerant Circuit

All units shall contain a sealed refrigerant circuit including a hermetic motor-compressor, discharge line muffler, bidirectional thermostatic expansion valve, all aluminum finned tube air-to-refrigerant heat exchanger, reversing valve, coaxial tube water-to-refrigerant heat exchanger, optional hot water generator coil, and service ports.

Compressors shall be high-efficiency dual capacity scroll type designed for heat pump duty and mounted on vibration isolators. Compressor motors shall be single-phase PSC with overload protection. The coil shall be sized for low-face velocity and constructed of lanced aluminum fins bonded to aluminum tubes in a staggered pattern not less than three rows deep for enhanced performance. Models shall include discharge mufflers to help quiet compressor discharge gas pulsations. Refrigerant to air heat exchangers shall utilize aluminum tube construction rated to withstand 600 psig (4135 kPa) refrigerant working pressure.

The coaxial water-to-refrigerant heat exchanger shall be designed for low water pressure drop and constructed of a convoluted copper (cupronickel option) inner tube and a steel outer tube. Refrigerant to water heat exchangers shall be of copper inner water tube and steel refrigerant outer tube design, rated to withstand 600 psig (4135 kPa) working refrigerant pressure and 450 psig (3101 kPa) working water pressure. The thermostatic expansion valve shall provide proper superheat over the entire liquid temperature range with minimal "hunting." The valve shall operate bidirectionally without the use of check valves.

All units shall have the source coaxial tube refrigerant-to-water heat exchanger and the optional hot water generator coil shall be coated with ThermoShield. Refrigerant suction lines shall be insulated to prevent condensation at low liquid temperatures.

Blower Motor and Assembly

The blower shall be a direct drive centrifugal type with a dynamically balanced wheel. The housing and wheel shall be designed for quiet low outlet velocity operation. The blower housing shall be removable from the unit without disconnecting the supply air ductwork for servicing of the blower motor. The blower motor shall be a 5-speed ECM.

Engineering Guide Specifications cont.

The ECM blower motor shall be soft starting, and shall provide 5 TAP settings. The blower motor shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated and have thermostatic overload protection. 5-speed ECM motors shall be long-life ball bearing type.

Electrical

A control box shall be located within the unit compressor compartment and shall contain a 75VA transformer, 24 volt activated, 2 pole compressor contactor, fuses for protecting loop pumps, terminal block for thermostat wiring, and solid-state controller for complete unit operation. Electromechanical operation WILL NOT be accepted. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 volt and provide heating or cooling as required by the remote thermostat/sensor. A microprocessor-based controller interfaces with a multi-stage electronic thermostat to monitor and control unit operation shall be provided. The control shall provide operational sequencing, blower speed control, high and low pressure switch monitoring, freeze detection, condensate overflow sensing, auxiliary heat staging, lockout mode control, and loop pump control, LED status and fault indicators, fault memory, field selectable options, and accessory output. The Lockout signal output shall have a pulsed option so that DDC systems can read specific lockout conditions from the control.

A detachable terminal block with screw terminals will be provided for field control wiring. All units shall have knockouts for entrance of low and line voltage wiring. The blower motor and control box shall be harness plug wired for easy removal.

Optional IntelliStart® (compressor Soft Starter) shall be factory installed for use in applications that require low starting amps, reduced compressor start-up noise, off-grid, and improved start-up behavior. IntelliStart shall reduce normal starting current by up to 60%.

Piping

Supply and return water connections shall be 1 in. [25.4 mm] FPT brass swivel fittings, which provide a union and eliminate the need for pipe wrenches and sealants when making field connections. The optional hot water generator shall have sweat type connections. All water piping shall be insulated to prevent condensation at low liquid temperatures, on the vertical units, the condensate connection shall be a 3/4 in. [19.1 mm] PVC socket with internally-trapped hose that can be routed to front or side locations.

Hanger Kit

(field-installed horizontal units only)

The hanger kit shall consist of galvanized steel brackets, bolts, lock washers, and isolators and shall be designed to fasten to the unit bottom panel for suspension from 3/8-inch threaded rods. Unit sizes 024-036 shall include four brackets. Unit sizes 048-072 shall include six brackets.

Options and Accessories

Cupronickel Heat Exchanger

An optional cupronickel water-to-refrigerant heat exchanger shall be provided.

Hot Water Generator

An optional ThermaShield coated heat reclaiming hot water generator coil of vented double-wall copper construction suitable for potable water shall be provided. The coil and hot water circulating pump shall be factory mounted inside the unit with integral electronic high limit temperature monitoring and external on/off switch.

Thermostat (field-installed)

A multi-stage auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer three heating and two cooling stages with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO blower switch, and indicating LEDs shall be provided. The thermostat shall display in °F or °C. The thermostat shall be a traditional 24 VAC type.

Electronic Air Cleaner (field-installed)

A 1 in. [25 mm] electronic air cleaner, cleanable 97% efficiency at 0.3 microns and larger, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.2 in. w.g. at 300 fpm force velocity.

Engineering Guide Specifications cont.

Electrostatic Air Cleaner (field-installed)

A 1 in. [25 mm] electrostatic air cleaner, cleanable 90% efficiency, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.15 in. w.g. at 300 fpm force velocity.

AlpinePure Drain Pan Treatment (field-installed)

Provides dependable, sustained time-release protection from slime build-up and foul smelling odors in the drain pan. Also adds a light, pleasant scent to the air.

Earth Loop Flow Center (field-installed)

A self-contained module shall provide all liquid flow, fill and connection requirements for ground source closed loop systems up to 20 gpm. The pumps shall be wired to a power block located in the nearest unit. The heat pump units shall contain low voltage pump slaving control so that two units may share one flow center.

Auxiliary Heater (field-installed)

An electric resistance heater shall provide supplemental and/or emergency heating capability. Vertical units shall have the control panel and resistance heater coil assembly mounted internally. For horizontal units, the control panel shall be mounted internally while the resistance heater coil assembly shall be mounted externally. A low voltage plug shall be provided in each unit for quick auxiliary heat connection. The heater shall operate in sequenced stages as controlled by the unit's microprocessor. The heater shall feed line voltage power to the unit blower and transformer to provide emergency heat capability in the event of an open compressor circuit breaker.

Revision Guide

Pages:	Description:	Date:	By:
All	Literature Creation	18 Sept 2014	MA

GEO*SMART* E N E R G Y



650 Jamieson Parkway, Unit #1, Cambridge, Ontario N3C 0A5 | o: 1.866.310.6690 | f: 1.866.533.3889

[GEO*SMART*ENERGY.COM](http://GEOSMARTENERGY.COM)

Product: **ECO-Y Series**
Type: Premium Forced Air Geothermal Comfort System

Size: 2-6 Ton Dual Capacity

Document Type: Specification Catalog
Ref. Number: SC2300AG2
Revision Date: 09/14
Revision Number:
Document Name: TEC-ECO-Y-0914v1

©2014 The manufacturer has a policy of continual product research and development and reserves the right to change design and specifications without notice.